


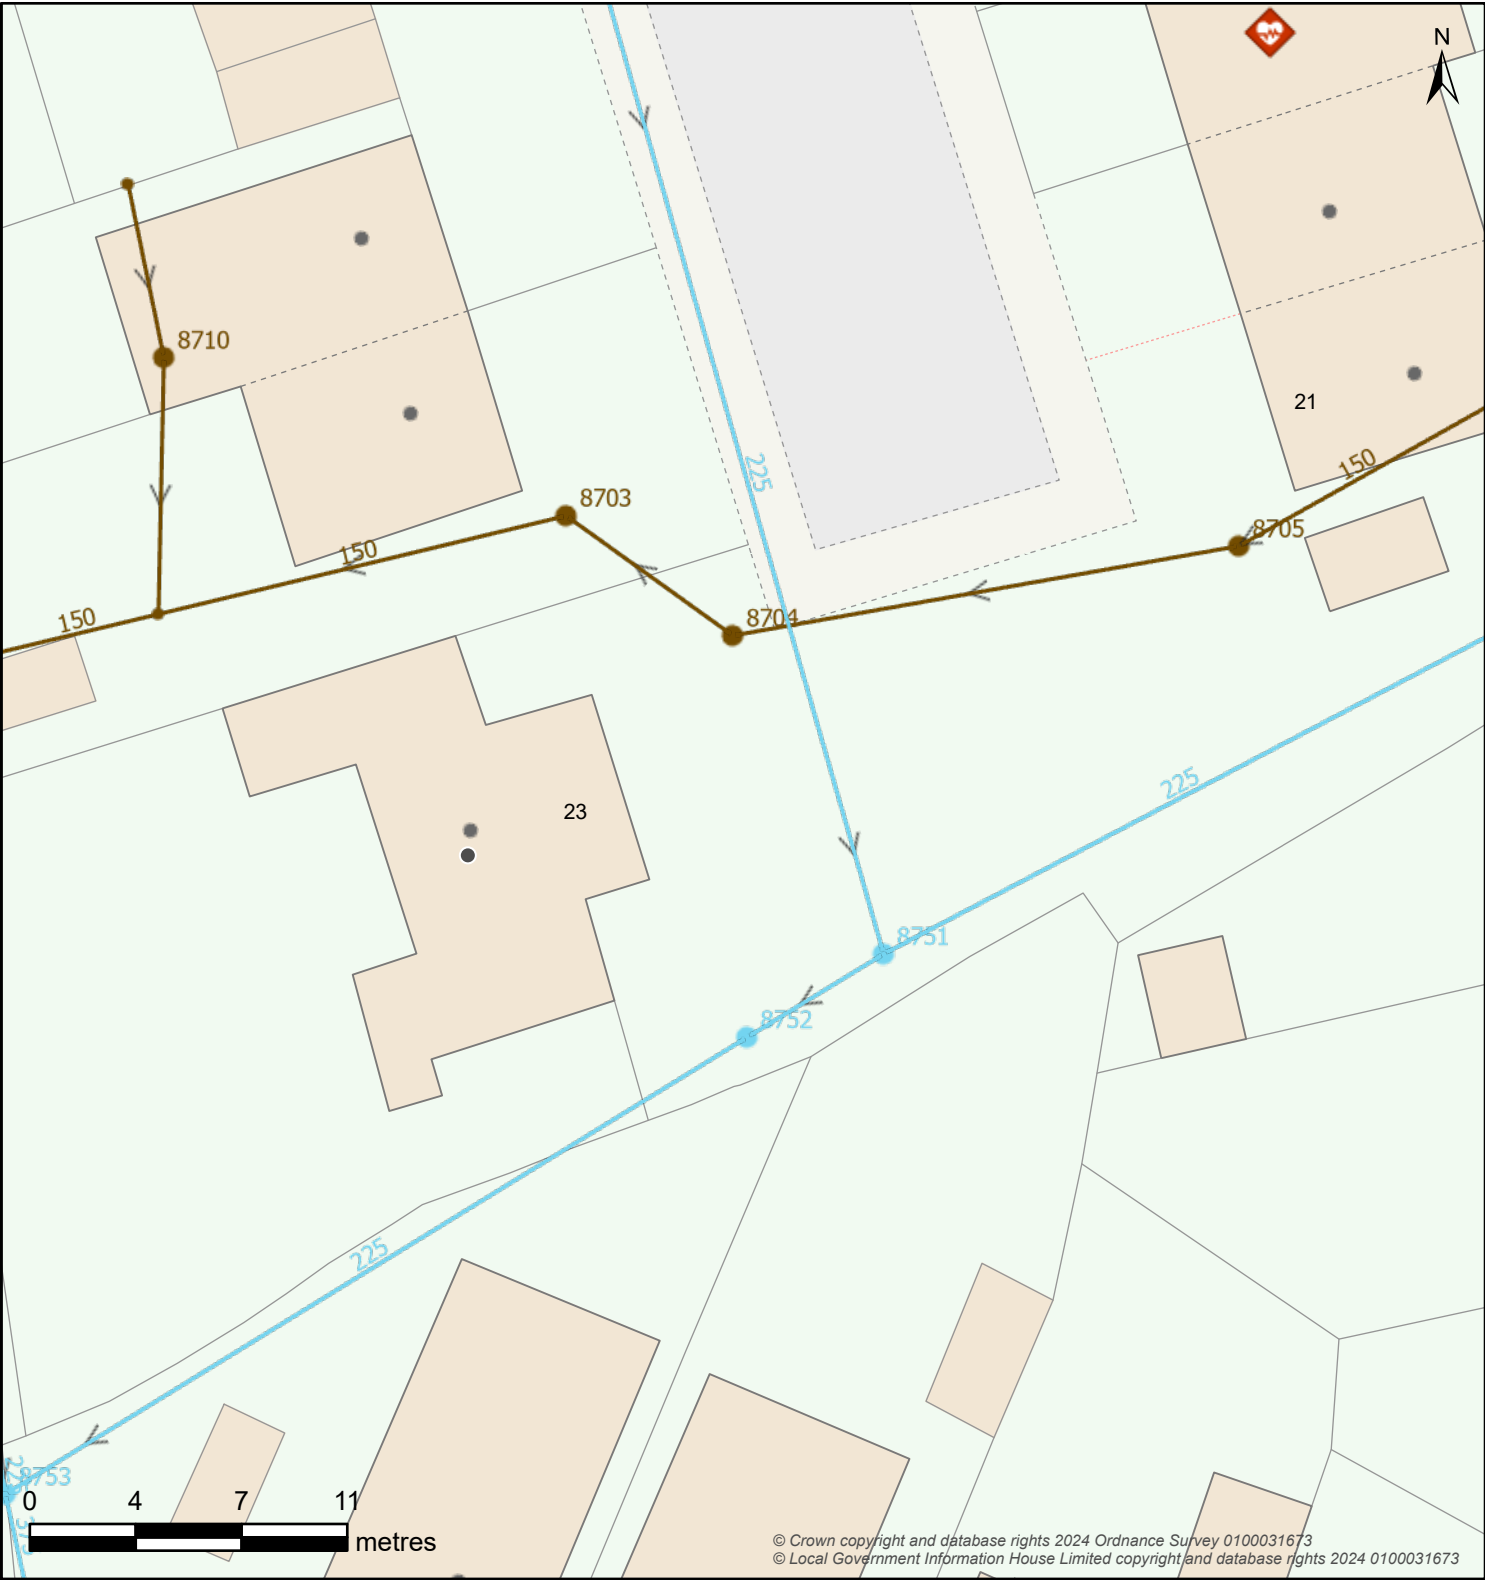

Boundary Box		Break Pressure Tank		Capped End		Hydrant		
<div><div></div></div> Boundary Box	<div><div>BPT</div></div> Break Pressure Tank	<div><div></div></div> Capped End	<div><div></div></div> Emptying Plug	<div><div></div></div> Fire Hydrant	<div><div></div></div> Washout Hydrant			
Pressure Monitoring		Service Reservoir		Meter		Valve - Controllable		
<div><div></div></div> Logger	<div><div></div></div> Covered	<div><div></div></div> Tower	<div><div></div></div> Meter	<div><div></div></div> Open Valve	<div><div></div></div> Closed Valve	<div><div></div></div> Stop Tap		
Site				Valve - Flow				
<div><div></div></div> Abstraction Point	<div><div></div></div> Supply Works	<div><div>AV</div></div> Air Valve	<div><div>NRV</div></div> Non-Return Valve	<div><div>WO</div></div> Washout Empty Valve				
<div><div></div></div> Booster Station	<div><div></div></div> Transfer Station	Valve - Pressure			Pipe Bridge			
<div><div></div></div> Surface Reservoir	<div><div></div></div> Underground Source	<div><div>PRV</div></div> Pressure Reducing Valve	<div><div>PSV</div></div> Pressure Sustaining Valve	<div><div></div></div> Pipe Bridge				
Water Pipe				Water Area				
<div><div></div></div> Communication	<div><div></div></div> Trunk	<div><div></div></div> Decommissioned		<div><div></div></div> Water Supply Zone	<div><div></div></div> District Meter Area			
<div><div></div></div> Distribution	<div><div></div></div> Raw	<div><div></div></div> Discolouration						
<div><div></div></div> Non-Potable	<div><div></div></div> Private							

Map Title: DSA000039264

Printed By: Karen.Denham

Date Printed: 13/12/2024

Map Scale: 250

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

