


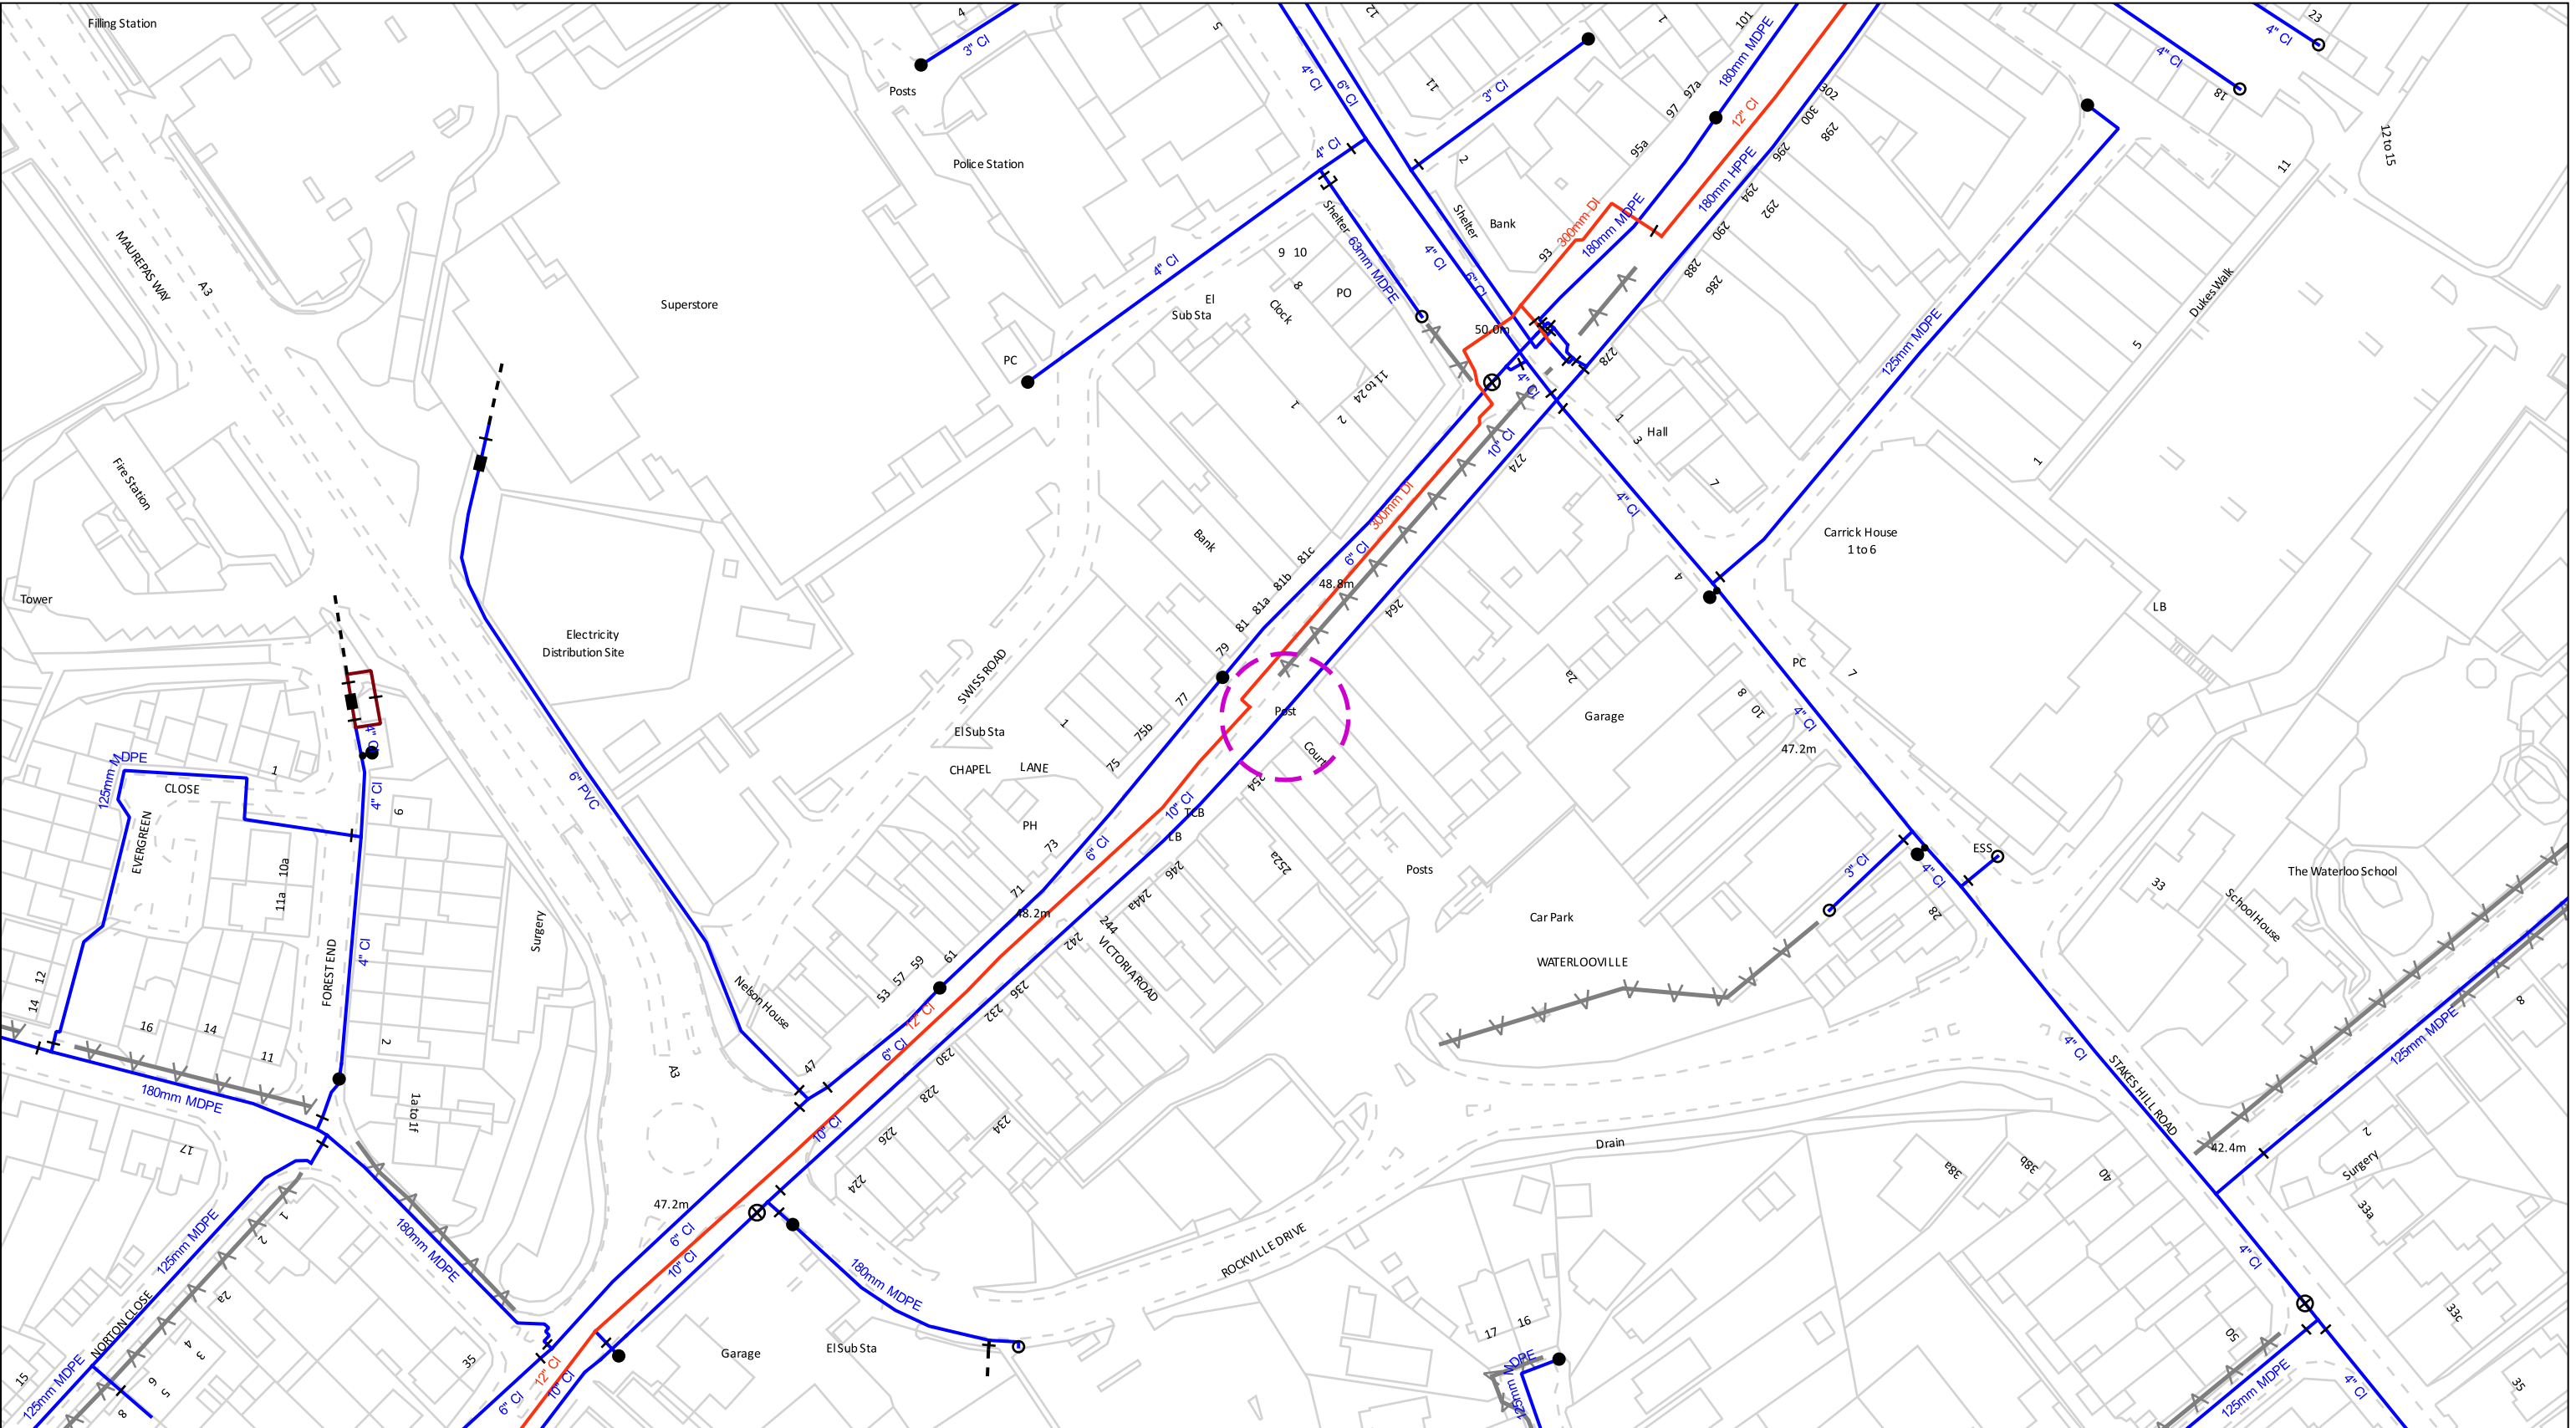

0100 m

Date Requested: 17/11/2025
Job Reference: 39458205
Site Location: 468138 109240
Requested by:
Mr Alex Robinson

Your Scheme/Reference:
APP/25/00833

Scale: 1:1250 (When plotted at A3)

Distribution Mains

Communication Pipe

Fire Main

Private Mains

Raw Water Main

Trunk Main

Abandoned Mains

Cable

○

Company Washout Hydrant (Single)

○

Company Washout Hydrant (Offset)

●

Fire Brigade Hydrant (Single)

●

Fire Brigade Washout Hydrant

*

Fire Brigade Hydrant (Offset)

▶

Reflux Valve

◆

Air Valve

|

Open Valve

↺

Closed Valve

]

Capped End

X

Stop Cock

⋈

Butterfly Valve

➤

Pressure Flow Valve

+

Meter

+

New Appointments & Variations

Assets within shaded area please contact:
Leep Utilities
Email: water@leeputilities.co.uk
Tel: 0345 122 6780

Registered Office

P.O. BOX NO. 8, West Street, Havant,
Hampshire. PO9 1LG.

Registered in England No. 2536455

Telephone: (023) 9249 9888

Fax: (023) 9245 3632

Website: www.portsmouthwater.co.uk

© Crown copyright and database rights 2025. Ordnance Survey Licence Number 100018036.
Warning: PDF designed for colour print only with no page scaling. This information is given as a guide only and its accuracy cannot be guaranteed
Plans generated by DigSAFE Pro™ software provided by LinesearchbeforeUdig.

(Page 1)