



Client: L & S WASTE MANAGEMENT LTD
PEGHAM INDUSTRIAL ESTATE
LAVEYS LANE
FAREHAM
HAMPSHIRE
PO15 6SD
F.A.O. STEVE KEW
Copies To:

Lab No.: D3348

PARTICLE SIZE DISTRIBUTION CERTIFICATE


Project: AGG. TESTS: L & S NOVEMBER 2018
Location: CLASS 2C STOCKPILE. PORTSDOWN HILL
Material: STONEY COHESIVE MATERIAL - GENERAL FILL
Specification: SHW SERIES 600 TABLE 6/2 CLASS 2C
Contractor: N/A
Supplier/Plant: L & S WASTE MANAGEMENT - PORTSDOWN HILL
Date Sampled: 02/11/2018
Sampled By: LB
Sample Type: BULK
Test Mass: 3270.2g
Ticket No.: N/A
Date Received: 02/11/2018
Tested By: AMW
Date Tested: 07/11/2018
Site Ref.: LB1 x 2 BAGS

TEST RESULTS

Preparation Method: BS EN932-2: 1999. Test Method: BS EN933-1: 2012

Sieve	Passing %	Specification
125mm	100	100
2mm	61	15 - 80
0.063mm	23	15 - 80

Test	Result	Specification
Moisture Content (%):	19.6	
Specified Size (%):		
Flakiness Index:		
Uniformity:		

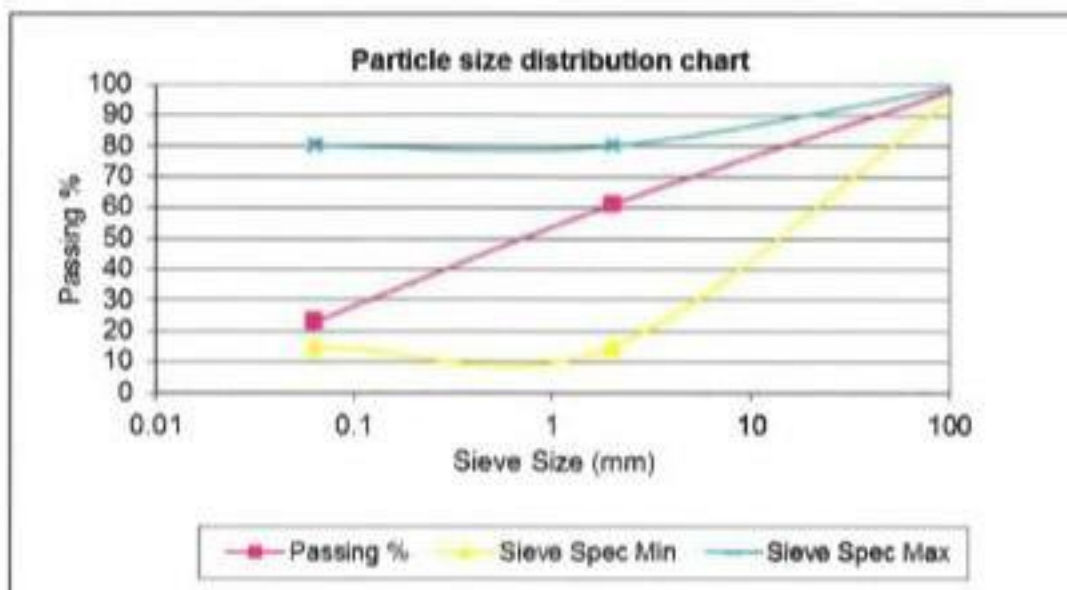

Category: A
This sample complies with the above specification.

Signed:.....

Approved Signatories: M. Mullane/E. Frost/M. Baker
Laboratory Manager/Senior Technician/Asst. Senior Technician

Date:..... 7/11/18.....



Opinions and interpretations expressed herein are outside the scope of UKAS accreditation.

Client: L & S WASTE MANAGEMENT LTD
PEGHAM INDUSTRIAL ESTATE
LAVEYS LANE
FAREHAM
HAMPSHIRE
PO15 6SD
F.A.O. STEVE KEW
Copies To:

Lab No.: **D3350**

PARTICLE SIZE DISTRIBUTION CERTIFICATE


Project:	AGG. TESTS: L & S NOVEMBER 2018		
Location:	6mm BLINDING SAND STOCKPILE. PORTSDOWN HILL		
Material:	LIFT & SHIFT RECYCLED BLINDING SAND		
Specification:	SUPPLIER DECLARED SPECIFICATION		
Contractor:	N/A		
Supplier/Plant:	L & S WASTE MANAGEMENT - PORTSDOWN HILL	Ticket No.:	N/A
Date Sampled:	02/11/2018	Date Received:	02/11/2018
Sampled By:	LB	Tested By:	AMW
Sample Type:	BULK	Date Tested:	07/11/2018
Test Mass:	2720.8g	Site Ref.:	LB3 x 3 BAGS

TEST RESULTS

Preparation Method: BS EN932-2: 1999. Test Method: BS EN933-1: 2012

Sieve	Passing %	Specification
10mm	100	100
6.3mm	100	70 - 100
2mm	68	30 - 80
1mm	51	20 - 60
0.5mm	38	10 - 50
0.063mm	11	0 - 20

Test	Result	Specification
Moisture Content (%) :	16.1	
Specified Size (%) :		
Flakiness Index :		
Uniformity :		

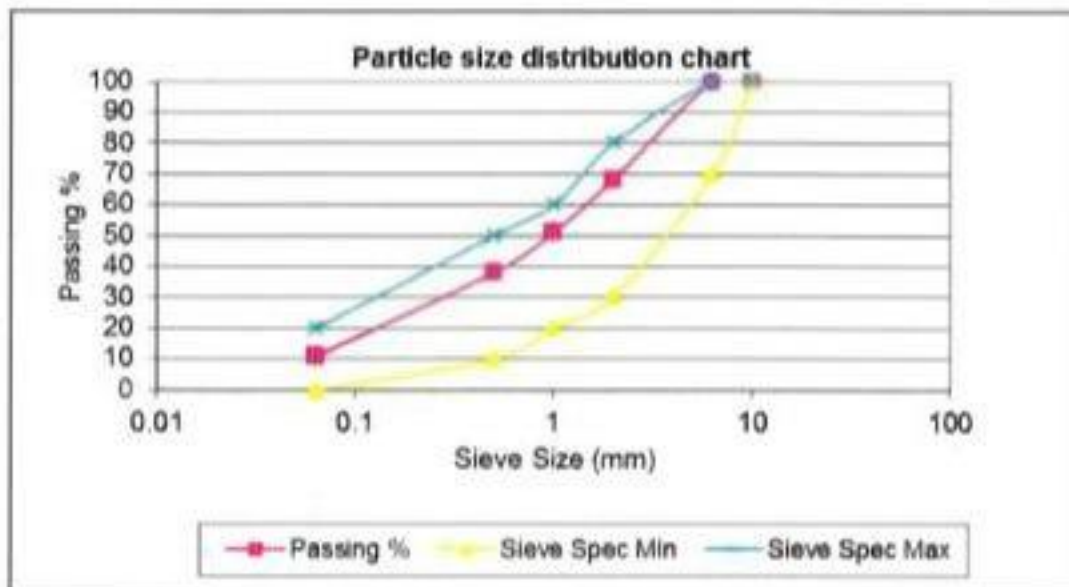

Category : **A**
This sample complies with the above specification.

Signed:.....

Approved Signatories: ~~M. Mullane/E. Frost/M. Baker~~
~~Laboratory Manager/Senior Technician/Asst. Senior Technician~~

Date:.....*7/11/18*.....



Opinions and interpretations expressed herein are outside the scope of UKAS accreditation.



Client: L & S WASTE MANAGEMENT LTD
PEGHAM INDUSTRIAL ESTATE
LAVEYS LANE
FAREHAM
HAMPSHIRE
PO15 6SD
F.A.O. STEVE KEW

Lab No.: D3349

Copies To:

PARTICLE SIZE DISTRIBUTION CERTIFICATE

Project: AGG. TESTS: L & S NOVEMBER 2018
Location: 20mm RECYCLED BALLAST STOCKPILE. PORTSDOWN HILL
Material: 20mm WASHED BALLAST
Specification: BS EN12620 AGGS. FOR CONC. 20mm ALL IN
Contractor: N/A
Supplier/Plant: L & S WASTE MANAGEMENT - PORTSDOWN HILL
Date Sampled: 02/11/2018
Sampled By: LB
Sample Type: BULK
Test Mass: 3999.6g


Ticket No.: N/A
Date Received: 02/11/2018
Tested By: AMW
Date Tested: 07/11/2018
Site Ref.: LB2 x 2 BAGS

TEST RESULTS

Preparation Method: BS EN932-2: 1999. Test Method: BS EN933-1: 2012

Sieve	Passing %	Specification
40mm	100	100
31.5mm	100	98 - 100
20mm	96	90 - 99
10mm	67	50 - 90
2mm	33	20 - 60
0.063mm	6	0 - 7

Test	Result	Specification
Moisture Content (%) :	6.8	
Specified Size (%) :		
Flakiness Index :		
Uniformity :		

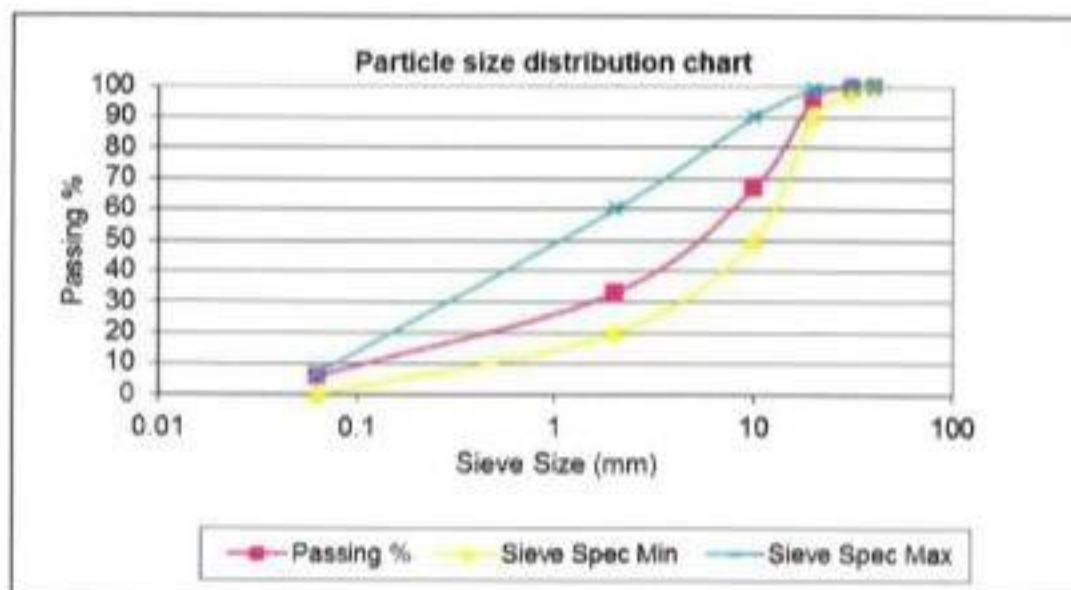

Category : A

This sample complies with the above specification.

Signed:.....

Approved Signatories: M. Mullane/E. Frost/M. Baker
Laboratory Manager/Senior Technician/Asst. Senior Technician

Date:..... 7/11/18



Opinions and interpretations expressed herein are outside the scope of UKAS accreditation.