

Noise Impact Assessment

Dunsbury Park Plot 400



Prepared for:
Portsmouth City Council

Prepared by:
Siena Lam

Date:
08 May 2026

Project/File:
333701960-STN-XX-XX-RP-AC-0003-S2-P01

Document control sheet

Issued by	Stantec UK Limited Great Suffolk Yard 127-131 Great Suffolk Street London SE1 1PP UNITED KINGDOM stantec.com	+44(0) 203 8468456 stantec.com
Client	Portsmouth City Council	
Project name	Dunsbury Park Plot 400	
Title	Noise Impact Assessment	
Doc ref	333701960-STN-XX-XX-RP-AC-0003-S2-P02	
Project number	333701960	
Status	S2	
Date	8 May 2026	

Document production record

Issue number	P02	Name
Prepared by		Siena Lam
Checked by		Laura Mazzeo
Approved by		James Glen

Document revision record

Issue number	Status	Date	Revision details
P01	S2	17/12/2025	First Issue
P02	S2	8/05/2026	Minor Amendments to site plans

Stantec UK Limited has prepared this report in accordance with the instructions of the above named client for their sole and specific use. Any third parties who may use the information contained herein do so at their own risk.



Table of Contents

Document control sheet	i
Glossary	1
1 Introduction	2
2 Site Description	4
2.1 Identified Noise Sensitive Receptors	6
3 Assessment Methodology.....	7
3.1 Policy and Guidance	7
3.1.1 Local Planning Policy: Havant Borough Council.....	7
4 Environmental Noise Survey	9
4.1 Overview	9
4.2 Survey Methodology and Equipment.....	9
4.3 Summary of Baseline Noise Levels	10
4.3.1 Long Term Measurement Results.....	10
4.3.2 Short-Term Measurement Results.....	11
5 Construction Phase Noise and Vibration Impacts	12
5.1 Overview	12
5.2 Noise from Construction.....	12
5.3 Vibration from Demolition and Construction Activities	13
6 Operational Phase Noise Impacts	15
6.1 Development Generated Road Traffic Noise	15
6.1.1 Traffic Data.....	15
6.1.2 Assessment Result	16
6.2 Noise Impact on Proposed Offices	19
6.3 Industrial Noise Impacts.....	19
6.3.1 Sound Sources and Associated Noise Levels	20
6.3.2 On-time Corrections	20
6.3.3 Background Noise Levels at NSRs.....	21
6.3.4 BS4142 Noise Assessment Results	22
6.3.5 Cumulative Industrial Impact.....	23
6.3.6 Noise Impacts on Proposed Noise Sensitive Receptors	25
7 Mitigation Measures.....	26
7.1 Noise & Vibration from Earthworks and Construction.....	26
7.1.1 Noise	26
7.1.2 Vibration	26
7.2 Façade Insulation Requirements	27
7.3 External Plant Requirements	28
8 Conclusion.....	29

List of Tables

Table 1 Environmental Noise Survey Equipment Details	10
Table 2 Long-term unattended Ambient and Background Sound Levels	11
Table 3 Short-term Attended Measurement Results	11
Table 4 BS5228-1 Threshold Category Values	12
Table 5 Appropriate Category Value for existing Noise Sensitive Receptors	13
Table 6 Distance at which Vibration may be Just Perceptible	14
Table 7 Predicted Noise Change in Traffic Noise Level on Fitzwygram Way – Daytime Period(06:00-24:00).....	16
Table 8 Predicted Noise Change in Traffic Noise Level on Fitzwygram Way – Night-time Period(23:00-07:00).....	16



Table 9 Predicted Noise Change at the existing NSRs – Daytime Period.....	17
Table 10 Predicted Noise Change at the existing NSRs – Night-time Period	18
Table 11 Summary of Specific Sound Sources and Levels Plot 400.....	20
Table 12 Background Sound Levels at the existing Noise Sensitive Receptors	21
Table 13 BS4142:2014 Assessment of operational noise level at the NSRs- Daytime	22
Table 14 BS4142:2014 Assessment of operational noise level at the NSRs– Night-time	22
Table 15 Summary of Specific Sound Sources and Levels at Plots 600 &601	23
Table 16 Cumulative BS4142:2014 Assessment of operational noise level at the NSRs - Daytime	23
Table 17 Cumulative BS4142:2014 Assessment of operational noise level at the NSRs – Night-time	24
Table 18 Preliminary Acoustic Specification for the Development	27

List of Figures

Figure 1 Site Location	4
Figure 2 Site Layout	5
Figure 3 Noise Sensitive Receptors	6
Figure 4 Environmental Noise Survey Locations.....	9

List of Appendices

Appendix A Policy and Guidance	
Appendix B 2023 Noise Survey Summary	
Appendix C 2025 Noise Survey Data	
Appendix D Traffic Data (Provided by Paul Basham Associates)	
Appendix E Modelling Assumptions	
Appendix F Potential Industrial Impact	
Appendix G Cumulative Industrial Impact	





Glossary

Term	Definition
dB (decibel)	The scale on which sound pressure level is expressed. Sound pressure level is defined as 20 times the logarithm of the ratio between the root-mean-square pressure of the sound field and a reference pressure (2x10 ⁻⁵ Pa).
dB(A)	A-weighted decibel. This is a measure of the overall level of sound across the audible spectrum with a frequency weighting (i.e. 'A' - weighting) to compensate for the varying sensitivity of the human ear to sound at different frequencies.
L _{Aeq,T}	L _{Aeq} is defined as the notional steady sound level which, over a stated period of time (T), would contain the same amount of acoustical energy as the A - weighted fluctuating sound measured over that period.
L _{Amax}	L _{Amax} is the maximum A - weighted sound pressure level recorded over the period stated. L _{Amax} is sometimes used in assessing environmental noise where occasional loud noises occur, which may have little effect on the overall L _{eq} noise level but will still affect the noise environment. Unless described otherwise, it is measured using the 'fast' sound level meter response.
L ₁₀ and L ₉₀	If a non-steady noise is to be described it is necessary to know both its level and the degree of fluctuation. The L _n indices are used for this purpose, and the term refers to the level exceeded for n% of the time. Hence L ₁₀ is the level exceeded for 10% of the time, and the L ₉₀ is the level exceeded for 90% of the time.
Free-field Level	A sound field determined at a point away from reflective surfaces other than the ground with no significant contributions due to sound from other reflective surfaces. Generally, as measured outside and at least 3m from buildings.
Future year	The 15th year after opening



1 Introduction

Stantec has been appointed by Portsmouth City Council to undertake a noise impact assessment in support of the planning application for the development of industrial/ logistics use at Plot 400 Dunsbury Park, Fitzwygram Cres, Havant PO9 4EE, hereinafter referred to as "The Site".

The proposal comprises the erection of flexible employment block, with outdoor car parking spaces including EV charging and HGV spaces. The development is to be under planning Use Class E(g)(ii) [Research and Development], E(g)(iii) [Light Industrial], B2 [General Industrial], and B8 [Storage and Distribution].

This report is broken down into the following sections:

- **Section 2: Site Description:** This section outlines the location of The Site, surrounding environment, the site proposals and the nearby Noise Sensitive Receptors (NSRs).
- **Section 3: Assessment Methodology:** This section provides an overview of the standards and policy which are relevant, as well as summarising the assessment criteria.
- **Section 4: Environmental Noise Survey:** This section provides a summary of the noise survey methodology, results, and observations of the local noise environment.
- **Section 5: Construction Phase and Vibration Noise Impacts:** This section evaluates the potential noise and vibration impacts arising from the construction phase, against relevant guidance criteria.
- **Section 6: Operation Phase Noise Impacts:** This section assessed the potential operation impacts. The section discussed the following noise impacts:
 - » Development Generated Road Traffic Noise at existing NSRs - Assesses predicted road traffic noise from the development at existing NSRs.
 - » Noise impacts at the proposed NSRs - Evaluates noise levels affecting NSRs within the development.
 - » Industrial Noise Impacts - Assesses the potential industrial noise sources, and the impacts on both the existing sensitive receptors and proposed NSRs within the development.
- **Section 7: Mitigation Measures:** This section presents mitigation measures to control noise and vibration impacts during both construction and operation.
- **Section 8: Conclusion**

This report is technical in nature; therefore, a glossary of acoustic terminology is provided at the start of this report to assist in understanding this report.

Limitations

Where modelling and prediction methods are used it should be noted that these are not a definitive indicator of the actual acoustic performance. Acoustic modelling and predictions should not therefore be relied upon as the sole means of assessing actual performance in operation. The advice herein is based on a combination of modelling, standard predictive calculation techniques, test data and Stantec's previous experience of similar constructions.



This report is based on information provided to Stantec by other parties. The report is provided strictly on the basis that the information that has been provided is accurate, complete and adequate. If the reader should become aware of any inaccuracy in or change to any of the facts, findings or assumptions, this should be raised accordingly.



2 Site Description

The Site is located at Dunsbury Park (Business park), Fitzwygram Cres, Havant PO9 4EE.

The Site is surrounded by existing industrial development to the west and south, with further proposed industrial use development to the northeast. The closest residential properties are located approximately 120 m to the east, and around 250 m to the west, across the A3(M) within Waterlooville.

The location of the site is presented in Figure 2.



Figure 1 Site Location

The proposed uses fall under Use Classes E(g)(ii), E(g)(iii), B2, and B8, and will include the construction of a single warehouse building with ancillary offices. The development also incorporates associated infrastructure, including car parking areas, a dedicated service yard and a HGV parking area. The proposed site layout is illustrated in Figure 2.

Noise Impact Assessment

Site Description



Figure 2 Site Layout

2.1 Identified Noise Sensitive Receptors

The nearest Noise Sensitive Receptors (NSRs) have been identified as:

- NSR1: Residential properties opposite to A3 Motorway to the west, approximately 120 m from The Site.
- NSR2: Residential properties along Calshot Road to the east, approximately 250 m from The Site.

The nearest Noise Sensitive Receptor locations are presented in Figure 3 below.



Figure 3 Noise Sensitive Receptors

3 Assessment Methodology

3.1 Policy and Guidance

The assessment methodology is based on the following policy and guidance documents:

- National Planning Policy Framework, 2024 (NPPF);
- Noise Policy Statement for England, 2010 (NPSE);
- Planning Practice Guidance – Noise, 2014 (PPG);
- Local Planning Policy: Building a Better Future Plan – Draft
- British Standard 8233 – Guidance on Sound Insulation and Noise Reduction for Buildings, 2014 (BS8233);
- The World Health Organisation’s Guideline for Community Noise, 1999 (WHO);
- BS 4142:2014 + A1 2019 – “Methods for rating and assessing commercial and industrial sound” (BS4142);
- British Standards 5228-1: 2009 + A1:2014 Code of practice for noise and vibration control on construction and open sites (BS5228);
- Design Manual for Road and Bridges - LA111 Noise and Vibration, 2020 (DMRB).
- Department for Transport's technical memorandum - Calculation of Road Traffic Noise, 1988 (CRTN).

A summary of the relevant planning policy and acoustics guidance is provided in Appendix A. The primary documents used are discussed below.

3.1.1 Local Planning Policy: Havant Borough Council

The adopted Local Plan is made up of the Core Strategy (2011) and the Site Allocations Plan (2014).

The local plan policy states the below in regard to noise:

DM10 Pollution

Development that may cause pollution of water, air or soil or pollution through noise, smell, smoke, fumes, gases, steam, dust, vibration, light, heat, electromagnetic radiation and other pollutants will only be permitted where all of the following relevant criteria can be met:

- 1. The health and safety of existing and future users of the site, or nearby occupiers and residents is not put at risk.*

The draft Building a Better Future Plan, currently going consultation, relevant policies have been considered in this report.

Policy 43: Amenity and Pollution

Development will be permitted where:



- a) Projected levels of noise, odour, vibration, light, water or air pollution from the development do not have a likely significant negative effect on the amenity of existing and future users of the site, nearby occupiers or the wider environment; or*
- b) Measures are provided which are suitable for the purposes intended and will ensure that any likely significant negative effect of pollution on receptors is mitigated to an acceptable level.*

How the policy will be implemented

4.430 Developers will need to submit sufficient information to establish whether a significant negative effect is likely to result from the development. The latest body of authoritative guidance (particularly planning practice guidance) will inform what amounts to a 'significant effect' or an 'acceptable level' in each case, and the definitions may refer to specific emissions or exposure standards, or to change relative to pre-development conditions. The level of information required will vary depending on the scale and nature of the development proposed. Where appropriate, the assessment should include the likely cumulative impact of development. Any significant negative effect should be mitigated to an acceptable level, having regard to the advice of relevant subject matter specialists regarding the proposed development.

Pre-application consultation was carried with the Environmental Health team in October 2025. The below comments were received:

Due to the proximity of residential dwellings to the proposed development site, a noise impact assessment would be expected to accompany any full application received, to determine predicted noise levels of deliveries and loading / unloading activities, and any plant or equipment to be used on site.

The acoustic report should be compiled by a person suitably qualified in acoustics and have full regard to all relevant guidance, including but not limited to, BS4142:2014+A1:2019 and BS8233:2014.



4 Environmental Noise Survey

4.1 Overview

Unattended environmental noise monitoring was previously carried out in 2023 to establish baseline sound levels at the nearby planning application for Plot 500 (APP/21/01267 – granted 23/12/2022). Results from the 2023 survey are provided as reference in Appendix B.

A new noise survey was undertaken in September 2025 to assess any changes in noise environment in the area.

4.2 Survey Methodology and Equipment

One unattended long-term measurement was undertaken between 4th September and 8th September 2025 to measure background sound levels in the area. Additional three short term attended measurements were carried out on the 4th of September 2025.

The survey locations are presented in Figure 4, indicated as “LT” and “ST” for long and short term, respectively.



Figure 4 Environmental Noise Survey Locations

Detailed Planning for Dunsbury Park Plot 400 | Portsmouth City Council | Noise Impact Assessment | 333701960-STN-XX-XX-RP-AC-0003-S2-P02

Noise measurements were made using Class 1 integrating sound level meters. Microphones were positioned vertically on a tripod at least 1.2m above the ground and at least 3.5m from any other reflecting surfaces. The sound level meters were calibrated to a reference level of 94 dB at 1kHz both prior to and on completion of the noise survey. No significant drift in calibration was noted during the survey (≤ 0.5 dB).

Monitoring was carried out by an Associate Member of the Institute of Acoustics (AMIOA). All measurement equipment has been laboratory calibrated within the appropriate calibration interval, biennially for sound level meters and annually for acoustic calibrators.

Full details of the equipment used are provided in Table 1.

Table 1 Environmental Noise Survey Equipment Details

Location	Manufacturer	Instrument	Type	Serial No./Version	Laboratory Calibration Due
LT1	01dB	Sound Level Meter	Fusion	12242	27 June 2026
		Pre-Amplifier	Pre22	1915123	
	G.R.A.S	Microphone	40CD	367053	
ST1 / ST2 / ST3	NTi	Sound Level Meter	XL2-TA	A2A-20385-E0	28 July 2026
		Pre-Amplifier	MA220	10704	
		Microphone	MC230A	A22997	

4.3 Summary of Baseline Noise Levels

4.3.1 Long Term Measurement Results

Measured noise levels at the long-term location(s) are presented in Table 2 for daytime (0700 to 2300 hours), night-time (2300 to 0700 hours) periods in terms of the following parameters:

- Equivalent Continuous Level (L_{Aeq}): the time averaged sound pressure level, defined as the equivalent steady level with the same total energy as the actual fluctuating sound level over the same time period. The equivalent continuous level is used for measurement of the ambient sound level in BS4142:2014.
- Background Sound Level (L_{A90}):- the sound level excluding the loudest 90% of the measurement time interval, i.e. excluding short-term events. The background sound level is used to represent the underlying steady noise level, which provides effective masking of intrusive sounds. Therefore, it is useful for the assessment of the noise impact from commercial, industrial and mechanical plant noise at existing residential receptors and is required for assessments based on the methodology described in BS4142:2014.

The equivalent continuous sound level (L_{Aeq}) in Table 2 has been calculated from a logarithmic average of the measurement results over the stated period. The representative background sound level (L_{A90}) has been determined from a statistical analysis of the 15-minute measurements over the period, in line with the approach recommended in BS4142:2014. The 10th percentile of the 15-minute background sound levels is, in most circumstances, considered a reasonable basis for a worst-case



BS4142 assessment, as this level is exceeded most of the time. This is supplemented by observations of the distribution plots of the background sound levels.

Time histories of the long-term measurement are provided in 0, and summary of the measured levels presented in Table 2.

Table 2 Long-term unattended Ambient and Background Sound Levels

Measurement Location	Time Period (hours)	Equivalent Continuous Sound Level	Representative Background Sound Level
		$L_{Aeq,15min}$ dB(A)	$L_{A90, 15 min}$ dB(A)
LT1	0700 – 2300	53	50
	2300 - 0700	46	42

Site observations were undertaken during the set up and collection of the monitoring equipment. During the site visits it was noted that the main noise source in the area was steady distant traffic noise from the A3 Motorway to the west, occasional local traffic noise from the nearby commercial site (i.e. Biopure Technology), and intermittent aircraft noise.

4.3.2 Short-Term Measurement Results

Measured noise levels at ST1, ST2 and ST3, along with the corresponding level at LT1 and their differences are shown in Table 3. These measurements are used to establish noise variation along the site, as well as a transfer function between the longer-term unattended measurement and the shorter terms attended measurements to quantify this variation.

Table 3 Short-term Attended Measurement Results

Measurement Location	Synchronous Measurement Period	Duration (minutes)	Background Noise Levels measured at the nearest Long-term monitoring ($L_{A90, 15min}$ dB)	Simultaneous short-term measurement ($L_{A90, 15min}$)	Difference (dB)
ST1	12:30-13:00	30	53 (LT1)	59	+6
ST2	13:15-13:45	30	53 (LT1)	49	-3
ST3	14:00-14:30	30	53 (LT1)	56	+3

Site observations during the short-term measurement periods:

- ST1: The primary source of noise at the site is traffic from the A3 Motorway to the west, with minor additional noise from the roundabout along Fitzwygram Way.
- ST2: Distant traffic noise from the A3 Motorway to the west, with occasional traffic noise from Calshoton Road.
- ST3: The primary noise source is traffic from the A3 Motorway to the east, with some background birdsong.

Both surveys indicate broadly similar noise conditions. The latest 2025 survey results show slightly lower ambient noise levels with a reduction of 6 dB and 5dB during daytime and night-time period respectively. Accordingly, this assessment is based on the latest survey data, also showing a robust assessment.

5 Construction Phase Noise and Vibration Impacts

5.1 Overview

Construction works have the potential to cause noise and vibration impacts beyond the Site boundary. At this stage, detailed information pertaining to site specific earthworks and construction activities are not known. Activities at the Site which could give rise to potential noise impacts typically include (but are not limited to):

- Site preparation e.g. ground excavation, levelling of ground, trenching, trench filling, unloading, levelling of hardcore and compact filling; and,
- Construction of the Proposed Development including piling, construction of access roads, fabrication processes e.g. planning, sanding, routing, cutting, drilling and laying foundations.

5.2 Noise from Construction

The contractor undertaking the Site preparation and construction works has not yet been appointed. However, it is considered that the enabling and construction works are likely to be restricted to standard daytime working hours, i.e. between 0800 and 1700 Monday to Friday, 0900 to 1200 on a Saturday, with no work on Sundays or Bank Holidays.

The appropriate noise impact threshold category value has been determined for all existing noise sensitive receptors, based on measured daytime ambient noise levels, in accordance with 'The ABC Method' provided in BS5228-1 as detailed in Table 4 below.

Table 4 BS5228-1 Threshold Category Values

Time Period	Category Threshold Value, dB(A)		
	Category A ^{*1}	Category B ^{*2}	Category C ^{*3}
Weekday Daytime (07:00 to 19:00) and Saturdays (07:00 to 10:00)	<65	70	>75

*1 Category A: Threshold values to use when ambient noise levels (when rounded to the nearest 5dB) are less than this value.

*2 Category B: Threshold values to use when ambient noise levels (when rounded to the nearest 5dB) are the same as category A values.

*3 Category C: Threshold values to use when ambient noise levels (when rounded to the nearest 5dB) are more than this value.



Noise Impact Assessment

Construction Phase Noise and Vibration Impacts

Table 5 below identifies the appropriate category value in order to determine whether there is potential for significant noise impact to occur during the earthworks and construction phase.

Table 5 Appropriate Category Value for existing Noise Sensitive Receptors

Existing Noise Sensitive Receptors (NSRs)	Representative Monitoring Location	Daytime Ambient Noise Level, dB LAeq, T	Rounded Level to the Nearest 5 dB(A)	Appropriate Category Value, according to BS5228-1	Significant Noise Impact Threshold, dB LAeq, T
NSR1	ST2	50	50	A	65
NSR2	ST3	56	55	A	65

Based on the transferred daytime ambient noise levels, the appropriate category for the NSRs in the vicinity of this Site has been determined as Category A. Therefore, the noise level above which activities from the construction phase might cause an impact at NSRs is 65dB(A).

The distance between the NSRs and the site boundary is more than 100m. Noise from construction phase activities are therefore likely to be attenuated over distance to an appropriate level at the NSRs. The Category A threshold value is therefore unlikely to be exceeded.

The levels of noise at NSRs closest to the Proposed Development will vary over the course of the construction period, depending on the sound power levels of equipment used, the distance to the properties, the presence of screening or reflective surfaces and the ability of the intervening ground to absorb propagating noise.

Although the threshold category is not likely to be exceeded, distant construction noise has the potential to be audible during short-term increases in noise levels, therefore best practice mitigation measures are recommended in order to minimise the potential for any noise impacts where practical. The recommendations should be secured via a suitably worded Construction Environmental Management Plan (CEMP). Further detail is provided in the Section 7 of this report.

5.3 Vibration from Demolition and Construction Activities

Structural damage to buildings associated with groundborne vibration is uncommon, and although vibration may be noticeable, there is little evidence to suggest that even cosmetic damage can occur, such as a crack in plaster, unless the magnitude of the vibration is high. The most likely impact, where elevated levels of vibration do occur, during the demolition and construction phases of development, is associated with perceptibility i.e., potential annoyance.

Where groundborne vibration is of a relatively continuous nature, there is a greater likelihood of structural damage occurring, compared to transient vibration. The only current national guidance document which provides a methodology for predicting levels of vibration from construction activities are BS5228- 2. The prediction method provided relates specifically to percussive, or vibratory, rolling and piling only.



Noise Impact Assessment

Construction Phase Noise and Vibration Impacts

Therefore, it is not possible to accurately predict levels of vibration during the Site preparation and the construction phase of Development. However, vibration impacts during Site activities other than piling are uncommon. As such, to control the impact of vibration during Site preparation and construction of a Development, limits relating to the perceptibility of vibration are typically set.

As stated in BS5228-2 and as generally accepted, the threshold of vibration perception for humans is typically in the Peak Particle Velocity (PPV) range of 0.14 mms⁻¹ to 0.3mms⁻¹, which forms the basis of the recommend maximum permitted vibration levels of 1 mms⁻¹ PPV within occupied residential dwellings.

Table 6 below sets out the distances (based on historical field measurements) at which certain activities could give rise to a just perceptible level of vibration.

Table 6 Distance at which Vibration may be Just Perceptible

Construction Activity	Distance from Activity at which Vibration may be Just Perceptible, metres
Excavation	30
Heavy Vehicles (e.g., Dump Trucks)	20
Notes: Vibration source data has been taken from DM Hiller and GI Crabb ' Groundborne vibration caused by mechanised construction works' and extrapolated to provide distance bounds. It should be noted that vibration is significantly variable and therefore these should be used as a guide only	

The nearest existing sensitive receptors to the proposed construction work, would vary depending upon the part of the Proposed Development under construction. As a worst-case scenario, demolition and construction works may potentially take place at a distance of approximately 120m from existing residential receptors to the north-western boundary of The Site.

At 120m, it is not likely that vibration due to heavy vehicles and the operation of construction machinery would be perceptible. Notwithstanding, methods of best practice should be implemented with regards to minimising potential vibration levels generated during the demolition and construction period.

Any required mitigation measures for the control of construction work noise and vibration should be implemented via a suitably worded Construction Environmental Management Plan (CEMP). Further guidance is provided in Section 7.



6 Operational Phase Noise Impacts

6.1 Development Generated Road Traffic Noise

The proposed development is anticipated to generate additional vehicle movements during its operational phase as a result of its potential employment and logistics use. An assessment has been undertaken to evaluate the potential impact from the development generated traffic on existing noise sensitive receptors.

It is understood that the proposed development at Plot 400 will share the same access road to Fitzwygram Way with the adjacent proposed Plots 600 and 601. To ensure a robust assessment, the combined traffic flows from all three plots have been considered.

The assessment has been carried out in accordance with LA111 – DMRB. Predicted traffic flows for both the Do-Minimum (without development) and Do-Something (with development) scenarios have been used to assess noise impacts in both the short term (baseline year) and long term (future assessment year).

The Basic Noise Level (BNL) have been calculated using the methodology set out in the Department for Transport's technical memorandum - Calculation of Road Traffic Noise, 1988 (DMRB). The assessment criteria are detailed in Appendix A.

6.1.1 Traffic Data

Traffic data for the assessment has been provided by the project transport consultants Paul Basham Associates. The full traffic forecasts data is reproduced in Appendix D.

It is understood that traffic generated by Plot 400, Plot 600&601 will travel along Fitzwygram Way, connecting directly to the A3 motorway to the west. Given the high existing traffic volumes on the A3, the additional traffic from the development is unlikely to have a noticeable impact on the motorway overall noise levels. Traffic on local links, such as Fitzwygram Way are more likely to be affected by the new development and therefore the potential impacts on the local network have been assessed.

While the DMRB Assessment aims to evaluate noise change resulting from project-induced traffic over both short-term and long-term periods, the noise changes in the basic noise level of Fitzwygram Way are considered to adhere the same principle even without factoring in road characteristic and propagation corrections.

The following data sets have been considered within the CRTN calculation:

Short-term impact:

- Do-Minimum in the opening year (2027)
- Do-Something in the opening year (2027)

Long-term impact:



- Do-Minimum in the opening year (2027)
- Do-Something in the future assessment year (2040¹)

6.1.2 Assessment Result

The predicted changes in road traffic noise levels for the cumulative development scenario during the daytime and night-time periods are presented in Table 7 and Table 8, respectively.

Table 7 Predicted Noise Change in Traffic Noise Level on Fitzwygram Way – Daytime Period(06:00-24:00)

Cumulative Developments (Plot 600, 601 and 400)				
Short-term	Predicted BNL - 2027 (w/o Dev.)	Predicted BNL - 2027 (w/ Dev.)	Noise Change	Level of Magnitude
	L _{A10} 18hr, dB	L _{A10} 18hr, dB	dB	
	57.3	60	2.7	Minor
Long-term	Predicted BNL - 2027 (w/o Dev.)	Predicted BNL - 2040 ¹ (w/ Dev.)	Noise Change	Level of Magnitude
	L _{A10} 18hr, dB	L _{A10} 18hr, dB	dB	
	57.3	60.2	2.9	Negligible

Table 8 Predicted Noise Change in Traffic Noise Level on Fitzwygram Way – Night-time Period(23:00-07:00)

Cumulative Developments (Plot 600, 601 and 400)				
Short-term	Predicted BNL - 2027 (w/o Dev.)	Predicted BNL - 2027 (w/ Dev.)	Noise Change	Level of Magnitude
	L _{A10} , 8hr, dB	L _{A10} , 8hr, dB	dB	
	45.6	48.4	2.7	Minor
Long-term	Predicted BNL - 2027 (w/o Dev.)	Predicted BNL - 2040 ¹ (w/ Dev.)	Noise Change	Level of Magnitude
	L _{A10} , 8hr, dB	L _{A10} , 8hr, dB	dB	
	45.6	47.4	1.7	Negligible

¹ The future assessment year is identified as 2042; however, traffic forecasts are based on 2040 data. This is because the TEMPro database, which is used for background traffic growth projections, currently only provides data up to 2040.



The results indicate that the predicted change in traffic noise is 2.7dB in the short term during daytime and night-time, and 2.9dB and 1.7dB in the long term, during daytime and night-time respectively. This results in a Minor level of magnitude during the short-term and Negligible in the long term.

However, these values represent Basic Noise Levels (BNL) on Fitzwygram Way only, calculated without considering road characteristics, propagation corrections, or the acoustic context of the surrounding environment. Accordingly, further analysis has been undertaken to assess the noise change at the receptors.

Ambient Noise Level and Distance Correction

The ambient noise levels at the existing Noise Sensitive Receptors (NSRs) have been established based on the long-term unattended measurements at LT1, in conjunction with the transfer differences identified during the short-term attended measurements, as outlined in Section 4.3.2.

Daytime and night-time noise levels at the NSR1 and NSR2, range from 50-56 dB L_{Aeq} and 43-49 dB L_{Aeq} , respectively. Site observations showed that the A3(M) motorway is the dominant noise source at both receptor locations. Traffic noise, including HGVs, already forms part of the existing noise environment at the existing receptors. Given this context, the additional traffic generated by the proposed developments on Fitzwygram Way is not expected to alter the overall noise characteristic of the area.

Furthermore, both receptors are located at a significant distance from the development site, approximately 100 m for NSR1 and 265 m for NSR2. Both receptors would benefit for the distance attenuation, making the local increase in noise less noticeable at the receptor's locations.

According to the traffic data, the increase in traffic flow associated with the development is relatively low, estimated at fewer than one vehicle per minute, and therefore its contribution to the total ambient noise climate will be minimal. Given that the traffic flow is not continuous, the source cannot reasonably be represented as a permanent line source. Instead, the distance loss has been applied with a conservative loss somewhere in between the two approximations-

Predicted Noise Change at Receptors

When distance corrections and ambient measured noise levels are taken into account, the predicted noise change at the receptors is presented in Table 9 and Table 10 for the daytime and night-time periods, respectively.

Table 9 Predicted Noise Change at the existing NSRs – Daytime Period

Cumulative Developments (Plot 600, 601 and 400)					
Receiver	Duration	Ambient Noise Level	Predicted Resultant Level	Noise Change	Level of Magnitude
		L_{Aeq} , dB	$L_{A10\ 18hr}$, dB	dB	
NSR1	Short-term	50	51.2	1.2	Minor

Noise Impact Assessment

Operational Phase Noise Impacts

NSR2	Long-term	50	51.2	1.2	Negligible
	Short-term	56	56.4	0.4	Negligible
	Long-term	56	56.4	0.4	Negligible

Table 10 Predicted Noise Change at the existing NSRs – Night-time Period

Cumulative Developments (Plot 600, 601 and 400)					
Receiver	Duration	Ambient Noise Level	Predicted Resultant Level	Noise Change	Level of Magnitude
		L _{Aeq} , dB	L _{A10 8hr} , dB	dB	
NSR1	Short-term	43	43.4	0.4	Negligible
	Long-term	43	43.4	0.4	Negligible
NSR2	Short-term	49	49.1	0.1	Negligible
	Long-term	49	49.1	0.1	Negligible

The results show that a short-term Minor impact is predicted at NSR 1 during daytime, while changes during the long-term assessment are classified as Negligible.

Given these findings, the cumulative impact of the proposed developments is considered as not significant, and therefore no noise mitigation measures are considered necessary.



6.2 Noise Impact on Proposed Offices

The Proposed Development will include ancillary office accommodation falling under Use Class E(g)(ii) and E(g)(iii). The potential noise impacts on future office spaces have been assessed.

According to BS8233, internal noise levels in office environment should typically fall between 35 and 50dB $L_{Aeq,30mins}$, depending on the type and sensitivity of the room. A conservative design target of 35 dB $L_{Aeq,30mins}$ has been adopted to provide a robust assessment in the absence of available layouts.

Daytime ambient noise levels at the proposed development site have been measured to be between 56 and 48 dB $L_{Aeq,16hrs}$.

An open window typically provides 13–15 dB noise reduction when partially open. Where façade levels exceed 50 dB(A), alternative means of ventilation may be required to achieve suitable internal levels.

It is understood that MVHR will be provided to supply background ventilation, enabling windows to remain closed to mitigate noise impacts.

A glazing specification has been identified to secure appropriate internal noise levels, as recommended by BS8233, with background ventilation provided via MVHR. The required mitigation scheme is presented in Section 7.

6.3 Industrial Noise Impacts

The development proposals include the provision of a flexible unit which could lawfully be used for Class E(g)(ii) and/or E(g)(iii) and/or B2 and/or B8 employment uses. These uses have the potential to generate noise and impact the nearby existing noise sensitive receptors during operation.

At the time of writing the exact use of the unit is not known, and the exact use may not be determined until practical completion, and a tenancy agreement has been signed by the occupying business(es).

To determine potential noise impacts and mitigation requirements at this stage, an assessment has been carried out based on proposed class use, 24hrs operation, and Stantec's experience of similar schemes, in accordance with BS4142.

The assessment is based on noise prediction modelling of the Proposed Development using a 3D noise model of the site created with SoundPLAN software based on the methodology described within CRTN and ISO 9613. Details of the model and assumptions are set out in Appendix E.



6.3.1 Sound Sources and Associated Noise Levels

In addition to noise break-out from within the warehouse, consideration has been given to external operational activities, including HGV movement, loading and unloading operations, idling engines, car parking and any ancillary plant associated with the office.

As detailed information on specific sound sources is not yet available at this stage of the design, the assessment has been based on representative noise data from Stantec's project archive, referencing similar development scheme. Internal and façade noise levels for manufacturing machinery are derived from back-calculations based on overall industrial noise activities. A summary of the adopted sound source data is provided in Table 11.

Table 11 Summary of Specific Sound Sources and Levels Plot 400

Planning Use Class	Potential Activities	Typical Noise Sources	Specific Sound Level, dB(A)
Class E(g)(ii) Research and Development, Class E(g)(iii) Light Industrial	Offices; associated car parking	HVAC ⁽¹⁾	70dB L _w
		Car parking ⁽²⁾	94 L _w
Class B2 General Industrial, Class B8 Storage and Distribution	Warehouse	Manufacturing machinery, internal noise ⁽⁴⁾	88 L _{pr,ev}
		Manufacturing machinery, façade noise level ⁽⁵⁾	42 L _w /m ²
		HGV Movement Noise	93dB L _w
		HGV Idling Engine Noise	85dB L _w
		Unload/loading Event (covered loading dock)	87dB L _w
		HGV Carparking ⁽²⁾	96 L _w

(1) 10 units assumed and 70dB sound power level assumed

(2) Carpark noise is predicted in SoundPLAN based on the number of allocated spaces in accordance with Parking Area Noise published by Bavarian State Office for the Environment in 2007

(3) Reverberant Sound Pressure Level

(4) Based on the internal sound pressure level and the break-out with a typical cladding system (i.e. Kingspan KS1000LS 100/140mm R_w 25dB).

6.3.2 On-time Corrections

In accordance with BS4142, the specific sound level should be corrected to reflect the on-time duration over the respective reference assessment period (Tr), 1-hour daytime (0700-2300) and 15 minute (2300-0700) night-time i.e. where noise occurs for less time than the duration of the reference assessment period the noise level should be adjusted.

24-Hour Continuous Operations

To provide a conservative and robust assessment, it has been assumed that certain sources operate continuously throughout both the daytime and night-time periods and no on-time corrections have been applied to these. These include:

- Internal operations / Building breakout;



- HVAC plants.

HGV Activity (HGV Movement, Loading and Idling)

The on-time of HGV activity has been derived using the traffic data provided by Paul Associates, as detailed in Appendix D. Based on the forecast number of daytime and night-time trips and HGV%, representative numbers of HGV events have been distributed across the relevant assessment periods.

Each HGV event includes HGV driving around site, loading/unloading and idling, although no night-time idling is assumed. On-time corrections were applied to each loading bay to reflect realistic operations, ensuring a robust assessment of potential noise impacts.

Car Parking Activity

Car parking activity has been represented by the number of vehicle movements per hour, per parking space, within each designated area of the model. The assessment focuses on the peak operational periods, typically when employees arrive and depart. During daytime conditions, it is assumed that 80% of parking spaces experience one vehicle movement within the reference hour. For the night-time period, this has been adjusted to 20% of spaces, reflecting a lower frequency of movements within a 15-minute reference period.

The above assumptions and on-time corrections are considered to provide a robust and representative basis for assessing operational noise associated with the Proposed Development.

6.3.3 Background Noise Levels at NSRs

The background noise levels at the existing Noise Sensitive Receptors (NSRs) have been established based on the long-term unattended measurements at LT1, in conjunction with the transfer differences identified during the short-term attended measurements, as outlined in Section 4.3.2.

Table 12 summarises the transferred Background Noise Levels for the daytime and night-time periods at each existing NSR.

Table 12 Background Sound Levels at the existing Noise Sensitive Receptors

Existing Noise Sensitive Receptors	Corresponding Measurement Location	Time Period (hours)	Transferred Background Noise Level L _{A90} dB(A)
NSR1	ST2	0700 – 2300	47
		2300 - 0700	39
NSR2	ST3	0700 – 2300	53
		2300 - 0700	45



6.3.4 BS4142 Noise Assessment Results

The potential industrial noise level has been predicted at the nearest ESRs and are summarised in Table 13 and Table 14, with a corresponding noise contour map provided in Appendix F.

Table 13 BS4142:2014 Assessment of operational noise level at the NSRs- Daytime

Description	Existing Noise Sensitive Receptors		Notes
	NSR1	NSR2	
Specific Sound Level ($L_{Aeq,dB}$)	44	42	Sound level at NSRs, predicted by SoundPLAN with the potential noise sources identified in Section 0.
Acoustic Character Correction	0	0	No acoustic correction has been applied.
Noise Rating Level ($L_{Ar,Tr}$ dB)	44	42	-
Background Sound Level ($L_{A90,T}$)	47	53	Identified Background Noise Level at NSR (See Section 6.3.3)
Margin below representative background Sound Level (dB)	3	11	-
Exceedance: Margin Below Limiting Noise Level (dB)	-3	-11	No exceedance

Table 14 BS4142:2014 Assessment of operational noise level at the NSRs– Night-time

Description	Existing Noise Sensitive Receptors		Notes
	NSR1	NSR2	
Specific Sound Level ($L_{Aeq,dB}$)	37	35	Sound level at NSRs, predicted by SoundPLAN with the potential noise sources identified in Section 0.
Acoustic Character Correction	0	0	No acoustic correction has been applied
Noise Rating Level ($L_{Ar,Tr}$ dB)	37	35	-
Background Sound Level ($L_{A90,T}$)	39	45	Identified Background Noise Level at NSR (See Section 6.3.3)
Margin below representative background Sound Level (dB)	2	10	-
Exceedance: Margin Below Limiting Noise Level (dB)	-2	-10	No exceedance

The predicted noise levels do not exceed the background sound levels at all NSR during both daytime and night-time periods. Accordingly, the potential operational noise impacts are considered not significant, and no mitigation measures are required.

6.3.5 Cumulative Industrial Impact

The predicted operational noise levels from Plot 400 individually do not exceed the relevant BS4142:2014 criteria. Nevertheless, the close proximity of Plots 600 and 601, which may also be developed into similar use classes, means that the cumulative effect should be considered to reflect the likely future scenario once all three developments are operational.

The cumulative assessment applies the same methodology used for Plot 400, including on-time corrections, operational assumptions, and source characteristics. The operational assumptions for Plots 600 and 601 are summarised in Table 15.

Table 15 Summary of Specific Sound Sources and Levels at Plots 600 & 601

Planning Use Class	Potential Activities	Typical Noise Sources	Specific Sound Level, dB(A)
Class E(g)(ii) Research and Development, Class E(g)(iii) Light Industrial	Offices; associated car parking	HVAC ⁽¹⁾	70dB L _w
		Car parking ⁽²⁾	92 L _w (Plot 601) 86 L _w (Plot 600)
Class B2 General Industrial, Class B8 Storage and Distribution	Warehouse	Manufacturing machinery, internal noise ⁽⁴⁾	88 L _{pr,ev}
		Manufacturing machinery, façade noise level ⁽⁵⁾	42 L _w /m ²
		HGV Movement Noise	93dB L _w
		HGV Idling Engine Noise	85dB L _w
		Unload/loading Event (covered loading dock)	87dB L _w
		HGV Carparking ⁽²⁾	95 L _w (Plot 601)

- (1) 4 units (Plot 600) and 10 units (Plot 601) assumed and 70dB sound power level assumed
(2) Carpark noise is predicted in SoundPLAN based on the number of allocated spaces in accordance with Parking Area Noise published by Bavarian State Office for the Environment in 2007
(3) Reverberant Sound Pressure Level
(4) Based on the internal sound pressure level and the break-out with a typical cladding system (i.e. Kingspan KS1000LS 100/140mm R_w 25dB).

The cumulative industrial noise levels at the nearest existing Noise Sensitive Receptors (NSRs) have been predicted using SoundPLAN V9.1, incorporating all sources from Plots 600, 601, and 400. The results are presented in Table 16 and Table 17, with a corresponding cumulative noise contour map provided in Appendix G.

Table 16 Cumulative BS4142:2014 Assessment of operational noise level at the NSRs - Daytime

Description	Existing Noise Sensitive Receptors		Notes
	NSR1	NSR1	
Specific Sound Level (L _{Aeq} , dB)	47	43	Sound level at NSRs, predicted by SoundPLAN with the potential noise sources identified in 6.3.1
Acoustic Character Correction	0	0	No acoustic correction has been applied.
Noise Rating Level (L _{Ar,Tr} dB)	47	43	-

Noise Impact Assessment
Operational Phase Noise Impacts

Description	Existing Noise Sensitive Receptors		Notes
	NSR1	NSR1	
Background Sound Level (L _{A90,T})	47	53	Identified Background Noise Level at NSR (See Section 6.3.3)
Margin below representative background Sound Level (dB)	0	20	-
Exceedance: Margin Below Limiting Noise Level (dB)	0	-20	No exceedance

Table 17 Cumulative BS4142:2014 Assessment of operational noise level at the NSRs – Night-time

Description	Existing Noise Sensitive Receptors		Notes
	NSR1	NSR1	
Specific Sound Level (L _{Aeq} ,dB)	39	35	Sound level at NSRs, predicted by SoundPLAN with the potential noise sources identified in 6.3.1.
Acoustic Character Correction	0	0	No acoustic correction has been applied
Noise Rating Level (L _{Af,Tr} dB)	39	35	
Background Sound Level (L _{A90,T})	39	45	Identified Background Noise Level at NSR (See Section 6.3.3)
Margin below representative background Sound Level (dB)	0	10	-
Exceedance: Margin Below Limiting Noise Level (dB)	0	-10	No exceedance

The cumulative predicted industrial noise levels at all NSRs remain below the representative background noise levels during both daytime and night-time periods. There is no exceedance of BS4142:2014 criteria. Accordingly, the potential operational noise impacts are considered not significant, and no mitigation measures are required.



6.3.6 Noise Impacts on Proposed Noise Sensitive Receptors

The potential impact of industrial noise from the Proposed Development has been assessed for noise-sensitive ancillary office areas within the development during daytime periods.

In order to predict the noise levels at the facades of the Proposed Development, the same propagation model principles applied in the above assessment was used.

In assessing the impact of industrial noise at office uses, the noise impacts should be considered internally, as there are no sensitive external locations.. BS4142 highlights that the standard is not intended to be applied to the assessment of indoor sound levels but recognises that the sensitivity of a receptor can be reduced and acceptable internal acoustic conditions achieved via the implementation of design measures, including façade insulation treatment, and ventilation strategies.

Furthermore, BS4142 states:

"Where a new noise-sensitive receptor is introduced and there is extant industrial and/or commercial sound, it should be recognised that the industrial and/or commercial sound forms a component of the acoustic environment. In such circumstances other guidance and criteria in addition to or alternative to this standard can also inform the appropriateness of both introducing a new noise-sensitive receptor and the extent of required noise mitigation."

It is understood that the offices will be mechanically ventilated. According to BS8233, the lowest internal ambient noise level for office use, including staff meeting and training rooms, is 35 dB $L_{Aeq,30min}$. The façade and wall construction, in combination with mechanical ventilation, is expected to provide approximately 30 dB $D_{nT,w}$ of noise reduction. Therefore, the façade noise level at office windows should not exceed 75 dB $L_{Aeq,T}$.

The predicted façade noise levels are below 70dB $L_{Aeq,T}$, demonstrating compliance with this criterion. The corresponding glazing and ventilation specifications are provided in the section below.



7 Mitigation Measures

7.1 Noise & Vibration from Earthworks and Construction

7.1.1 Noise

To reduce the potential for noise impact from the earthworks and construction phase of the Proposed Development at NSRs in the immediate vicinity of the Site, mitigation measures are recommended, as previously discussed in section 5.

Best working practice should be implemented during each phase of the earthworks and construction works at the Site, which would include the following measures, in accordance with the guidelines in BS5228-1 and in BRE Controlling particles, vapour and noise pollution from construction Sites, Parts 1 to 5, 2003:

- When works are taking place within close proximity to those sensitive receptors identified, screening of noise sources by temporary screen may be employed;
- All plant and machinery should be regularly maintained to control noise emissions, with particular emphasis on lubrication of bearings and the integrity of silencers;
- Site staff should be aware that they are working adjacent to a residential area and avoid all unnecessary noise due to misuse of tools and equipment, unnecessary shouting and radios;
- A further measure to reduce noise levels at the sensitive receptors would include, as far as possible, the avoidance of two noisy operations occurring simultaneously in close proximity to the same sensitive receptor;
- Specification of working hours during the week and at weekends;
- Ensure engines are turned off when possible;
- Should earthworks/earthworks and construction activities need to be carried out during nighttime hours, the local authority could include a planning condition which requests advance notice and details of any night working to be provided; and,
- A clear Site notice board should be accessible to residents with a point of contact on Site responsible for ensuring and complaints are addressed expediently.

The above methods of best practice should be implemented via a suitably worded CEMP, to be provided by the contractor, together with the required noise impact threshold, 65dB L_{Aeq} (Category A).

7.1.2 Vibration

BS5228-2 indicates that mitigation could include the use of alternative methods i.e. substitution, removal of obstructions, provision of cut-off trenches, reduction of energy input per blow, reduction of resistance to penetration, where necessary.

As the programme and methodologies become more defined, demolition and construction vibration should be reviewed by a suitably qualified acoustician and a detailed strategy for control devised and implemented via the CEMP, where appropriate.



7.2 Façade Insulation Requirements

Façade insulation for the offices at The Site is required in the form of glazing and/or alternative ventilation to achieve suitable internal noise conditions in accordance with BS8233 and BS4142.

In order to determine the requirements for façade insulation, noise break calculations have been carried out in accordance with the 'more rigorous' method outlined in BS8233, using the level of noise at proposed facades.

When carrying out internal noise level predictions, the following assumptions have been made:

- Windows are closed,
- A reverberation time of 0.5 seconds in office rooms;
- The composite wall system, i.e. Kingspan cladding with internal dry lining, will provide a sound reduction performance ($R_w + C_{tr}$) that is at least 5dB better than the specified glazing.
- Any curtain walling system should also provide a performance 5dB better than the specifications of the glazing;
- Atmospheric side terminations of MVHR units (and ventilators if adopted) should have nominalised weighted element difference ($D_{n,e,w}$) 5dB higher than the specified ($R_w + C_{tr}$) of the glazing; and,
- Self-generated MVHR noise, if adopted, will be suitably attenuated.

Glazing and ventilation performance requirements are summarised in Table 18 and example configurations have been provided.

Table 18 Preliminary Acoustic Specification for the Development

Preliminary minimum sound reduction performance (dB)		Example configuration
Glazing (R_w)	Ventilation Performance ($D_{n,e,w}$)	
31	36	<ul style="list-style-type: none"> • 4mm glazing/120mm airgap/4mm glazing • Mechanical ventilation with Heat Recovery

It is understood that the development will implement MVHR, allowing windows to remain shut to mitigate noise whilst maintaining appropriate background ventilation rates. However, a review of the MVHR system should be carried out at the technical design stage to ensure that that system generated noise is suitable attenuated, as well as ensuring the insulation performance of the façade is not compromised by the normalised weighted element difference ($D_{n,e,w}$) of the atmospheric side terminations.

Where there are no noise sensitive rooms on facades then there would be no specific requirements for façade insulation. The requirements for façade insulation are subject to the final materials used for construction. The guidance contained herein is therefore subject to development during detailed design and should not be used for tender purposes.

7.3 External Plant Requirements

The external HVAC units impact has been included in the industrial noise impact assessment Section 6.3.1, and plant numbers included in Table 11. These values are assumptions for the assessment only, as the final plant selections have not yet been confirmed.

Once detailed plant specifications are available during the technical design stage, a BS4142 assessment should be carried out to evaluate the cumulative noise from all fixed plant at existing noise sensitive receptors to ensure significant effects are avoided. This assessment should consider whether the plant noise is intermittent, tonal, impulsive, or otherwise distinctive, and apply any appropriate feature corrections in line with the standard.

In the meantime, it is recommended that consideration should be given to the location of external and/or externally terminating fixed plant, utilising inherent building screening and the mitigation measures proposed herein to minimise the need for additional mitigation. Provisions should also be made for the selection of low-noise equipment, silencers, localised screens, and other attenuation measures where necessary.

A review of plant noise emissions should be undertaken by a suitably qualified acoustician once final plant specifications are available.



8 Conclusion

Stantec has been appointed to carry out a noise assessment to accompany a detail application for Plot 400 at Dunsbury Park, Fitzwygram Cres, Havant PO9 4EE.

Assessments have been carried out to consider the potential for impacts in accordance with relevant Planning Policies and British Standards, and with reference to the development layout.

A summary of the key noise considerations for the assessment are as follows:

- Construction Phase:
 - » Construction noise and vibration impacts on existing Noise Sensitive Receptors (NSRs);
- Operational phase:
 - » Development generated road traffic noise at existing NSRs;
 - » Noise impact on proposed NSRs;
 - » Industrial noise on existing NSRs; and,
 - » Industrial noise on proposed NSRs.

An updated noise survey has been carried out at and around the proposed development site. The results of which have been used to support the assessments together with the use of noise modelling software SoundPLAN V9.1.

Based on the results of the survey, the existing NSRs in the vicinity of the Site are classified as 'Category A' in accordance with BS5228-1. Therefore, level above which construction phase noise may cause significant impact at is 65 dB(A) $L_{Aeq,T}$.

Methods to reduce the potential construction noise and vibration impacts have been outlined in Section 7 of this report. The recommendations should be included within a Construction Environmental Management Plan (CEMP), to be provided by the contractor.

The predicted increase in road traffic noise arising from the Plot 400, 600 and 601 is assessed to be minor and negligible at the identified nearby noise sensitive receptors. Therefore, no significant impacts are anticipated.

The assessment of existing noise affecting proposed sensitive receptors indicates that internal noise levels can be maintained within acceptable limits through the application of standard façade treatments.

Predicted operational noise levels indicate no significant impact at existing NSRs. For proposed NSRs, within the proposed development, industrial noise levels are predicted to remain below the guideline internal noise criteria set out in BS8233:2014, assuming the use of standard thermal double glazing and alternative ventilation on the most exposed facades.



Noise Impact Assessment

Conclusion

An example glazing and ventilation scheme has been provided in Section 7, to mitigate existing ambient and future industrial noise associated with the Proposed Development, at internal noise sensitive office uses. These recommendations should be reviewed during detailed design.



Appendix A Policy and Guidance

National Planning Policy Framework (NPPF)

Published in December 2024, this document sets out the Government's planning policies for England and supersedes the previous version of the NPPF published in 2023. It makes the following reference to noise in the section entitled Conserving and enhancing the natural environment:

“187. Planning policies and decisions should contribute to and enhance the natural and local environment by:

[...]

e) preventing new and existing development from contributing to, being put at unacceptable risk from, or being adversely affected by, unacceptable levels of soil, air, water or noise pollution or land instability. Development should, wherever possible, help to improve local environmental conditions such as air and water quality, taking into account relevant information such as river basin management plans.”

It also makes the following references to noise in the Section entitled Ground conditions and pollution:

“198. Planning policies and decisions should also ensure that new development is appropriate for its location taking into account the likely effects (including cumulative effects) of pollution on health, living conditions and the natural environment, as well as the potential sensitivity of the site or the wider area to impacts that could arise from the development. In doing so they should:

a) mitigate and reduce to a minimum potential adverse impacts resulting from noise from new development and avoid noise giving rise to significant adverse impacts on health and the quality of life⁷²;

b) identify and protect tranquil areas which have remained relatively undisturbed by noise and are prized for their recreational and amenity value for this reason.

72 See Explanatory Note to the Noise Policy Statement for England (Department for Environment, Food & Rural Affairs, 2010).”

And

“200. Planning policies and decisions should ensure that new development can be integrated effectively with existing businesses and community facilities (such as places of worship, pubs, music venues and sports clubs). Existing businesses and facilities should not have unreasonable restrictions placed on them as a result of development permitted after they were established. Where the operation of an existing business or community facility could have a significant adverse effect on new development (including changes of use) in its vicinity, the applicant (or ‘agent of change’) should be required to provide suitable mitigation before the development has been completed.”

Noise Policy Statement for England (NPSE)

Published in March 2010, the Noise Policy Statement for England (NPSE) sets out the long-term vision of Government noise policy as follows:

“Promote good health and good quality of life through the effective management of noise within the context of Government policy on sustainable development.”

The NPSE identifies three observed effect levels, names “No Observed Effect Level” (NOEL), “Lowest Observed Adverse Effect Level” (LOAEL) and “Significant Observed Adverse Effect Level” (SOAEL).

The NPSE contains little detail on assessment methodologies and specific parameters at which the varying observed effect levels would occur in the context of a residential development.

Planning Practice Guidance (PPG)

The table below provides a summary of the noise exposure hierarchy, as described within Planning Practice Guidance (PPG).

Response	Examples of outcomes	Increasing effect level	Action
No Observed Effect Level			
Not present	No Effect	No Observed Effect	No specific measures required
No Observed Adverse Effect Level			
Present and not intrusive	Noise can be heard, but does not cause any change in behaviour, attitude or other physiological response. Can slightly affect the acoustic character of the area but not such that there is a change in the quality of life	No Observed Adverse Effect	No specific measures required
Lowest Observed Adverse Effect Level			
Present and intrusive	Noise can be heard and causes small changes in behaviour, attitude or other physiological response, e.g. turning up volume of television; speaking more loudly; where there is no alternative ventilation, having to close windows for some of the time because of the noise. Potential for some reported sleep disturbance. Affects the acoustic character of the area such that there is a small actual or perceived change in the quality of life	Observed Adverse Effect	Mitigate and reduce to a minimum
Significant Observed Adverse Effect Level			
Present and disruptive	The noise causes a material change in behaviour, attitude or other physiological response, e.g. avoiding certain activities during periods of intrusion; where there is no alternative ventilation, having to keep windows closed most of the time because of the noise. Potential for sleep disturbance resulting in difficulty in getting to sleep, premature awakening and difficulty in getting back to sleep. Quality of life diminished due to change in acoustic character of the area	Significant Observed Adverse Effect	Avoid
Present and very disruptive	Extensive and regular changes in behaviour, attitude or other physiological response and/or an inability to mitigate effect of noise leading to psychological stress, e.g. regular sleep deprivation/awakening; loss of appetite, significant, medically definable harm, e.g. auditory and non-auditory.	Unacceptable Adverse Effect	Prevent

BS 8233:2014 - Guidance on sound insulation and noise reduction for buildings

As discussed above, there is no specific guidance contained within the Planning Condition and the NPSE. In lieu of this, the approach that is generally adopted when assessing environmental noise sources on residential developments is to undertake an assessment in accordance with BS 8233: 2014.

BS 8233 provides guidance for the control of noise in and around buildings. The guidance provided within the document is applicable to the design of new buildings, or refurbished buildings undergoing a change of use, but does not provide guidance on assessing the effects of changes in the external noise levels to occupants of an existing building. The guidance provided includes appropriate internal and external noise level criteria which are applicable to dwellings for steady external noise sources. It is stated that it is desirable that the internal ambient noise level does not exceed the following criteria set out in the table below:

Activity	Location	Period	
		Daytime (07:00 to 23:00 hrs)	Night-time (23:00 to 07:00 hrs)
Resting	Living room	L _{Aeq,16hrs} 35 dB	-
Dining	Dining room/area	L _{Aeq,16hrs} 40 dB	-
Sleeping (daytime resting)	Bedroom	L _{Aeq,16hrs} 35 dB	L _{Aeq,8hrs} 30 dB

Whilst BS 8233:2014 recognises that a guideline value may be set in terms of SEL or L_{AFmax} for the assessment of regular individual noise events that can cause sleep disturbance during the night-time, a specific criterion is not stipulated. Accordingly, reference has been made in this assessment to the World Health Organisation (WHO) 1999: Guidelines for Community Noise below.

World Health Organisation (WHO) 1999: Guidelines for Community Noise

As with the 'good' and 'reasonable' criteria in BS 8233, the L_{AFmax} criterion in BS8233 is largely concordant with the World Health Organisation (WHO) guidance 1999: Guidelines for community noise. This document draws upon guidance from Vallet and Vernay, which states:

"For good sleep, it is believed that indoor sound pressure levels should not exceed approximately 45 dB L_{AFmax} more than 10-15 times per night"

BS 4142:2014 - Methods for rating and assessing commercial and industrial sound

BS 4142 describes methods for rating and assessing sound from industrial and manufacturing processes, fixed installations which comprise mechanical and electrical plant and equipment, the loading and unloading of goods and materials at industrial and/or commercial premises and mobile plant and vehicles that are an intrinsic part of the overall sound emanating from premises or processes.

The methods use outdoor sound levels to assess the likely effects of sound on people who might be inside or outside a dwelling or premises used for residential purposes upon which sound is incident.

If appropriate, the specific sound level of the source ($L_{Aeq,T}$) is corrected, by the application of one or more corrections for acoustic features to give a 'rating' level ($L_{Ar,Tr}$). The Standard effectively compares and rates the difference between the rating level of the sound and the prevailing background sound level ($L_{A90,T}$). Comparing the rating level with the background sound level, BS 4142 states:

"Typically, the greater this difference, the greater the magnitude of impact. A difference of around +10 dB or more is likely to be an indication of a significant adverse impact, depending on the context."

A difference of around +5 dB is likely to be an indication of an adverse impact, depending on the context."

The lower the rating level is relative to the measured background sound level, the less likely it is that the specific sound source will have an adverse impact or a significant adverse impact. Where the rating level does not exceed the background sound level, this is an indication of the specific sound source having a low impact, depending on the context."

British Standard 5228: 2014 - Code of Practice for noise and vibration control on construction and open sites

Noise from Construction Plant and Vehicles

Guidance on the assessment of noise from development sites is given in British Standard 5228-1:2009+A1:2014 "Code of Practice for noise and vibration control on construction and open Sites – Part 1: Noise" (BS5228-1), and BRE Controlling particles, vapour and noise pollution from construction Sites, Parts 1 to 5, 2003.

In addition to the guidance from the local authority, the Control of Pollution Act 1974 (COPA 1974) gives the local authority power to serve a notice under Section 60 imposing requirements as to the way in which works are to be carried out. This could specify times of operation, maximum levels of noise which may be emitted and the type of plant which should or should not be used.

However, it might be preferable for the chosen contractor to obtain prior consent under Section 61 of COPA 1974. Section 61 enables anyone who intends to carry out works to apply to the local authority for consent.

Under Section 61 the local authorities and those responsible for construction work, have an opportunity to settle any problems, relating to the potential noise, before work starts.

The threshold of potential significant effect at a nearby noise sensitive receptor in accordance with BS5228-1, Annex E, is set out in the table below. The level is based on the ambient noise level at the site, when rounded to the nearest 5dB. The limit value is then compared to the site noise level to determine the potential for effect.

Example threshold of potential significant effect at dwellings			
Assessment Category and Threshold Value Period ($L_{Aeq,T}$)	Threshold Value, in decibels (dB)		
	Category A _A)	Category B _B)	Category C ^{C)}
Night-time (23:00- 07:00)	45	50	55

Example threshold of potential significant effect at dwellings

Evening and weekends ^{D)}	55	60	65
Daytime (07:00 - 19:00) and Saturdays (07:00 - 13:00)	65	70	75

Note 1: A potential significant effect is indicated if the $LA_{eq,T}$ noise level arising from the site exceeds the threshold level for the category appropriate to the ambient noise levels.

Note 2: if the ambient noise level exceeds the Category C threshold values given in the table (i.e. the ambient noise level is higher than the above values), then a potential significant effect is indicated if the total $LA_{eq,T}$ noise level for the period increases by more than 3dB due to site noise.

Note 3: Applied to residential receptors only.

A) Category A: Threshold values to use when ambient noise levels (when rounded to the nearest 5dB) are less than this value.

B) Category B: Threshold values to use when ambient noise levels (when rounded to the nearest 5dB) are the same as category A values.

C) Category C: Threshold values to use when ambient noise levels (when rounded to the nearest 5dB) are more than this value.

D) 19:00 – 23:00 weekdays, 13:00-23:00 Saturdays and 07:00 – 23:00 Sundays.

LA111 Noise and Vibration – Design Manual for Roads and Bridges, 2020 (DMRB)

The Design Manual for Roads and Bridges (DMRB), published by National Highways, is a suite of documents which contains requirements and advice relating to works on motorway and all-purpose trunk roads for which one of the Overseeing Organisations is highway or road authority.

Although the DMRB strictly applies to new road schemes, where this project does not include, the principles of the approach contained within the document can also be applied to the assessment of noise from road traffic in general.

DMRB provides guidance on evaluating the magnitude of short-term and long-term impact associated with development generated road traffic during operational phases of a development, based on any predicted change in 18hour noise level $LA_{10, 18\text{hour}}$ (06:00 and 24:00).

Magnitude of impact at the existing sensitive receptors (ESRs) associated with noise from operation road traffic should be determined in accordance with the criteria recommended by DMRB guidance (Table 3.54a, Table 3.54b and Table 3.58 of DMRB), as shown in the table below.

Magnitude of change – Short-term and Long-term

Level of Magnitude	Short term noise change (dB $LA_{10,18\text{hr}}$ or L_{night})	Long term noise change (dB $LA_{10,18\text{hr}}$ or L_{night})	Significance
Major	≥ 5.0	≥ 10.0	Significant
Moderate	3.0 - 4.9	5.0 - 9.9	
Minor	1.0 - 2.9	3.0 - 4.9	Potentially Significant (Long-term)
Negligible	0.1 - 0.9	0.1 - 2.9	Not significant(short-term)
No Change	0	0	Not significant

The short-term and long-term impact shall be determined following the scenario below:

- Short-term: Do-Minimum opening year (DMOY) (without the proposed development) against Do-Something opening year (DSOY) (with the proposed development)
- Long-term: Do-Minimum scenario opening year (DMOY) (without the proposed development) against Do-Something future year1 (DSFY) (with the proposed development)

Where there is permanent change in magnitude of 1 dB $L_{A10,18h}$ in the short-term scenario or 3 dB $L_{A10,18h}$ in the long-term scenario, a recommendation on the scope of further assessment is required.

Calculation of Road Traffic Noise (CRTN), 1988

This document outlines standard procedures for calculating noise levels from road traffic. The calculation methods use a number of input variables, including traffic flow volume, average vehicle speed, percentage of heavy goods vehicles, type of road surface, site geometry and the presence of noise barriers or acoustically absorbent ground. CRTN predicts the L10 (18hour) dB(A) or L10 (1hour) dB(A) noise level for any receptor point at a given distance, up to 300 m, from the road.

The calculation in this report specifically focus on factors such as traffic flow (Q), speed(V) and heavy vehicle percentages(p), excluding the road characteristic and propagation corrections. The following equations are applied when predicting the basic noise level.

- Basic noise level:

$$L_{10(18-hour)} = 29.1 + 10\log_{10}Q \text{ dB(A)}$$

- Correction for mean traffic speed and percentage of heavy vehicles:

$$Correction = 33\log_{10}\left(V + 40 + \frac{500}{V}\right) + 10\log_{10}\left(1 + \frac{5p}{V}\right) - 68.8 \text{ dB(A)}$$

Appendix B 2023 Noise Survey Summary


Long-term unattended Ambient and Background Sound Levels

Measurement Location	Time Period (hours)	Equivalent Continuous Sound Level	Representative Background Sound Level
		L _{Aeq,15min} dB(A)	L _{A90, 15 min} dB(A)
LT1	0700 – 2300	59	58
	2300 - 0700	51	50

Short-Term Measurement Results


Measurement Location	Synchronous Measurement Period	Duration (minutes)	Background Noise Levels measured at the nearest Long-term monitoring (L _{A90, 15min} dB)	Simultaneous short-term measurement (L _{A90, 15min})	Difference (dB)
ST1	28 Sep 2023 12:30-13:00	30	60 (LT1)	53	-7

Measurement Locations

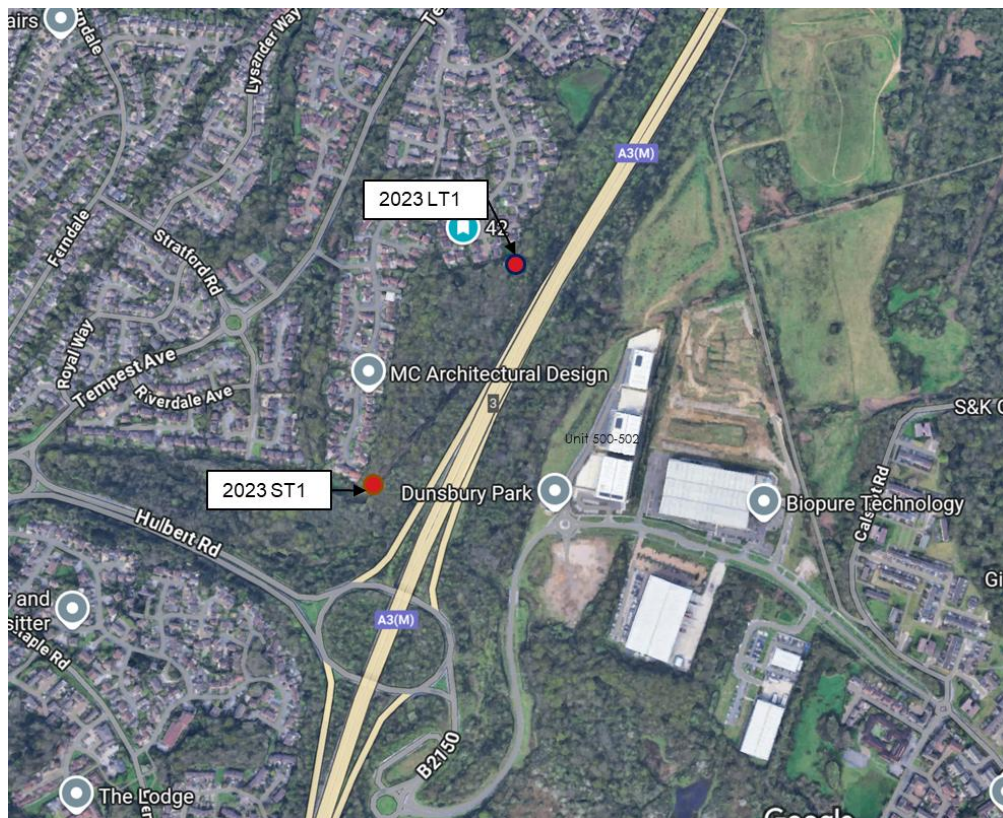


Monitoring Position 1

Thursday 28th to Friday 29th September 2023

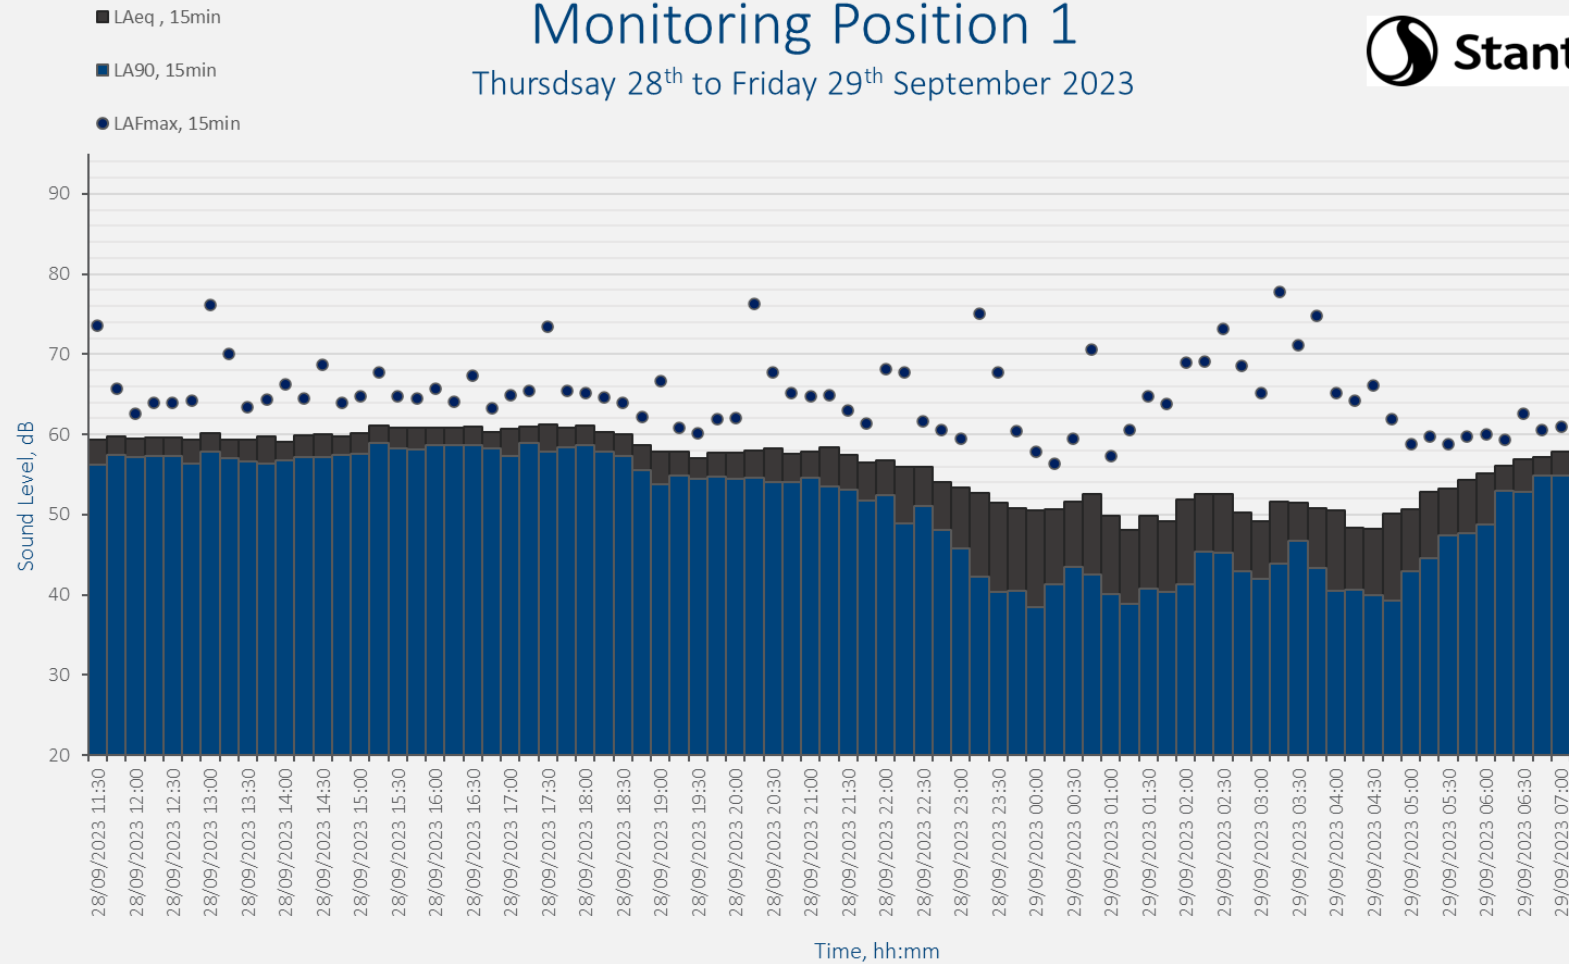


Monitoring Position 1

Friday 29th to Saturday 30th September 2023

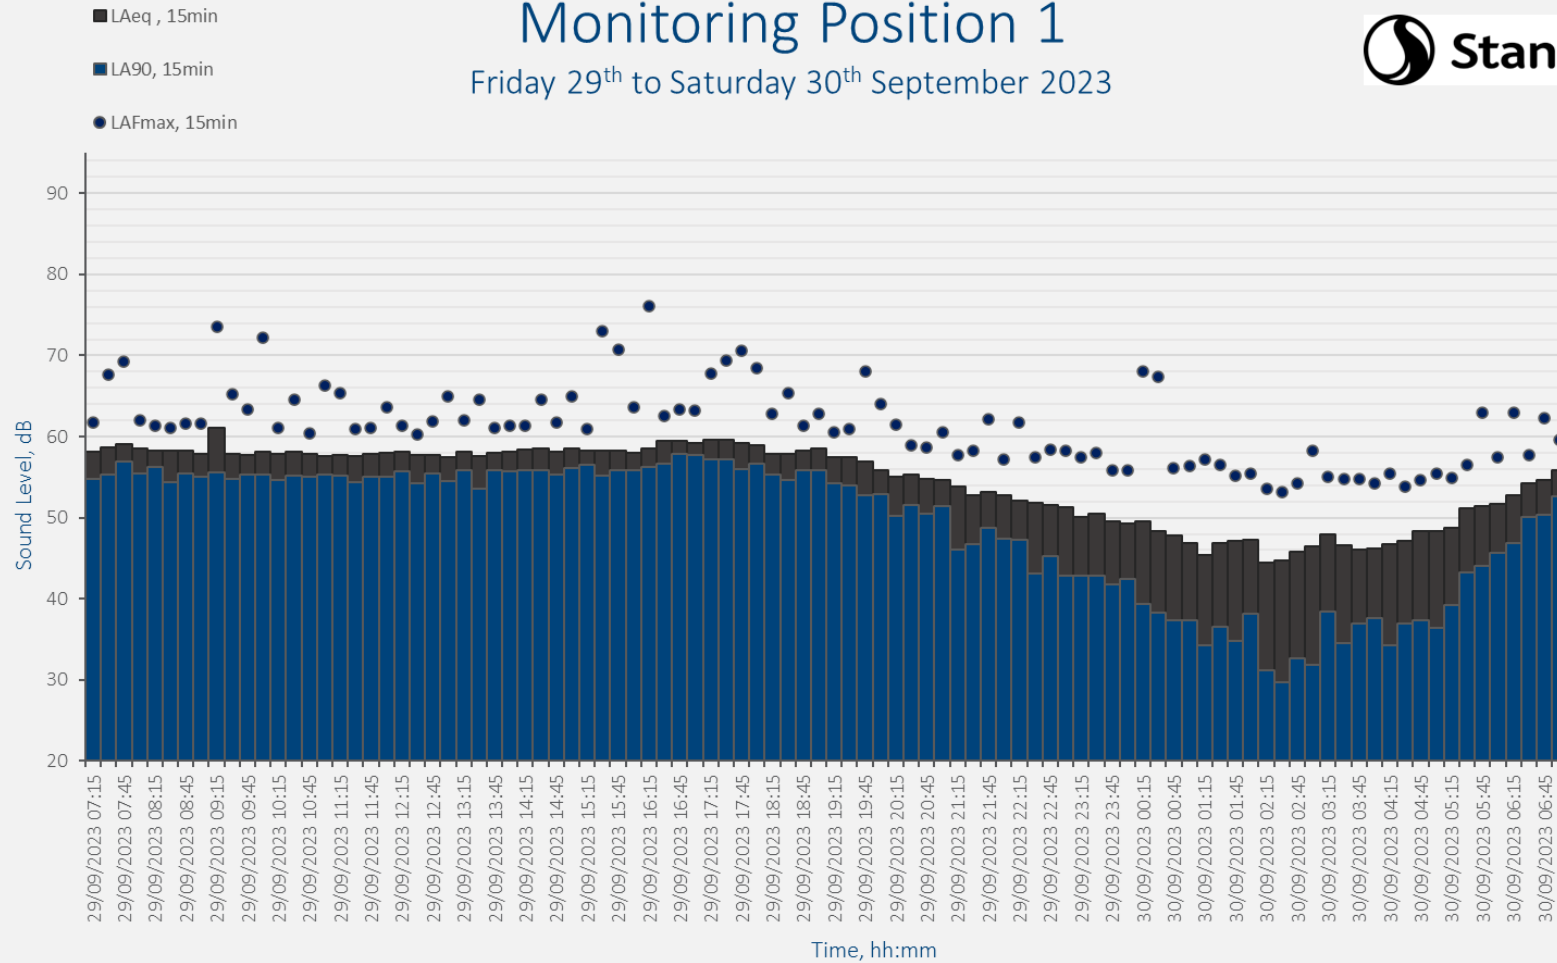

Monitoring Position 1

Saturday 30th September to Sunday 1st October 2023

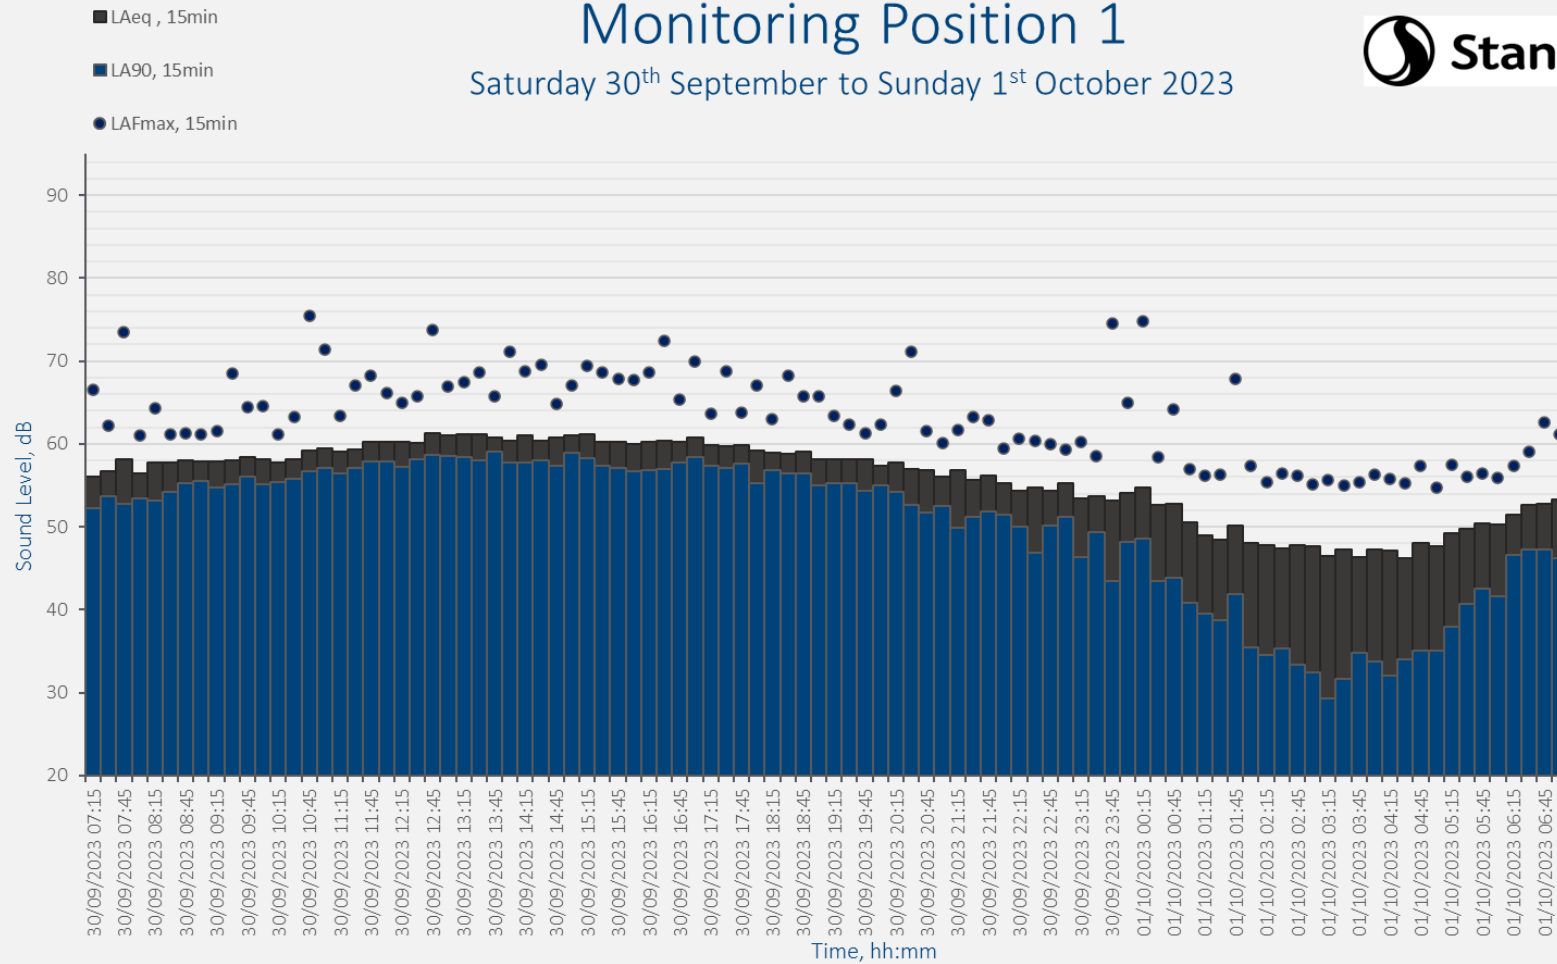


■ LAeq, 15min

■ LA90, 15min

● LAFmax, 15min


Monitoring Position 1

Sunday 1st to Monday 2nd October 2023

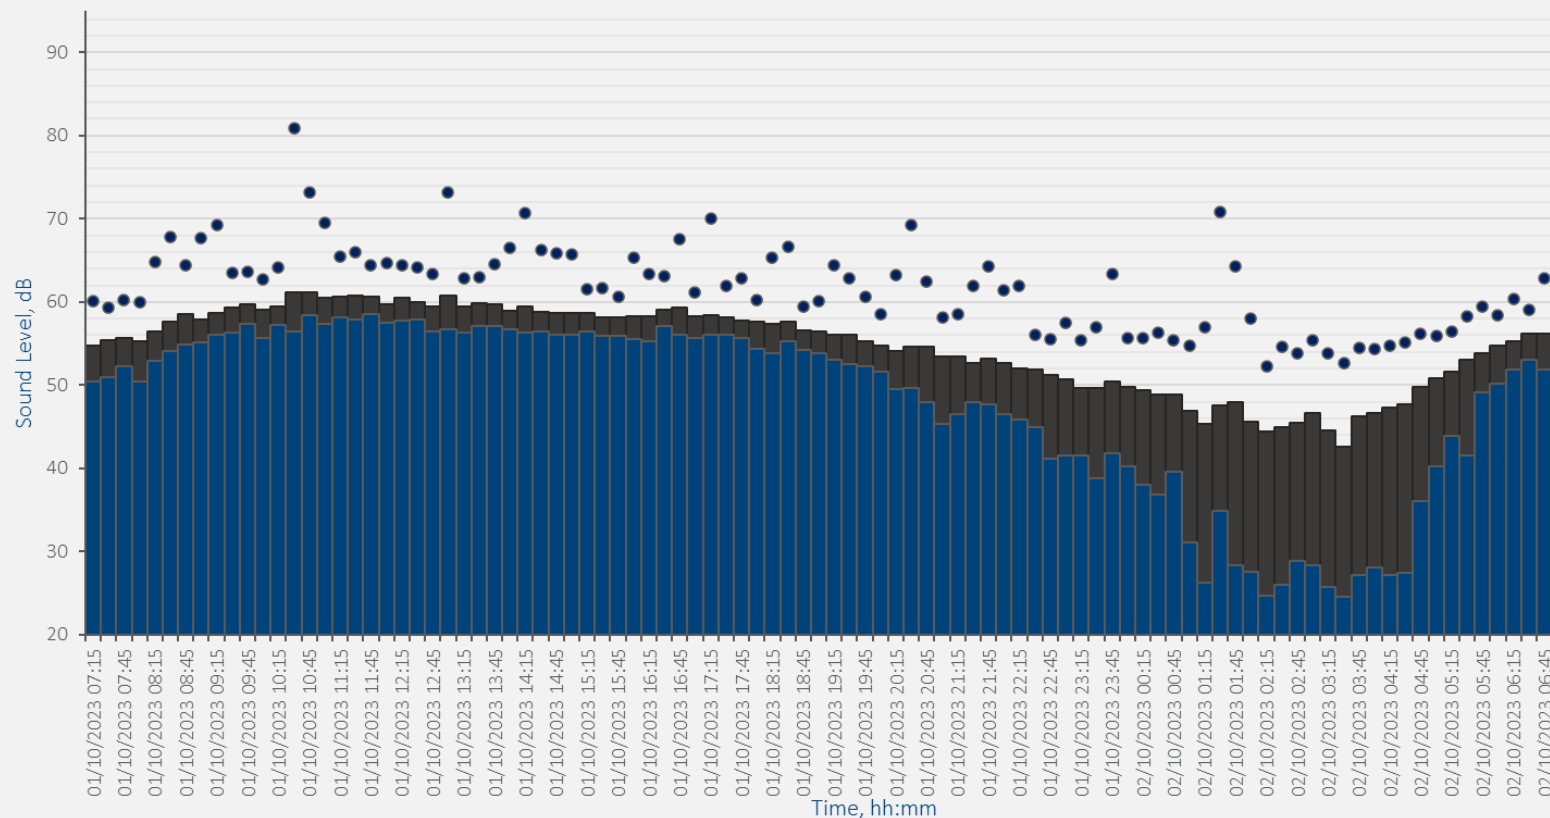


Monitoring Position 1


Monday 2nd October 2023

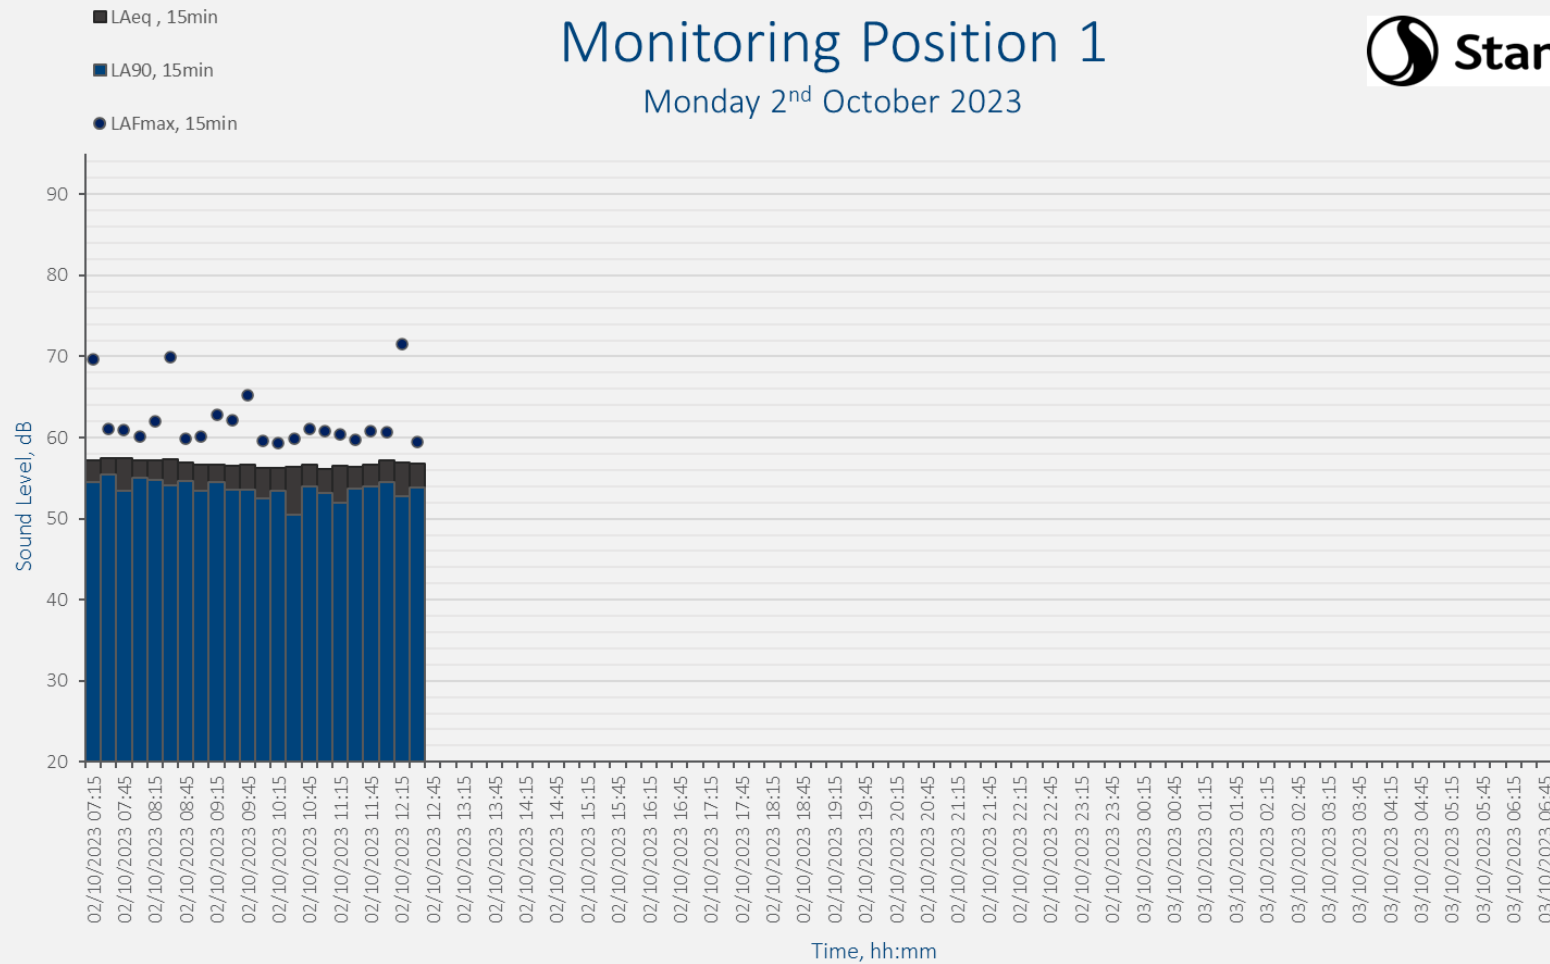


Appendix C 2025 Noise Survey Data

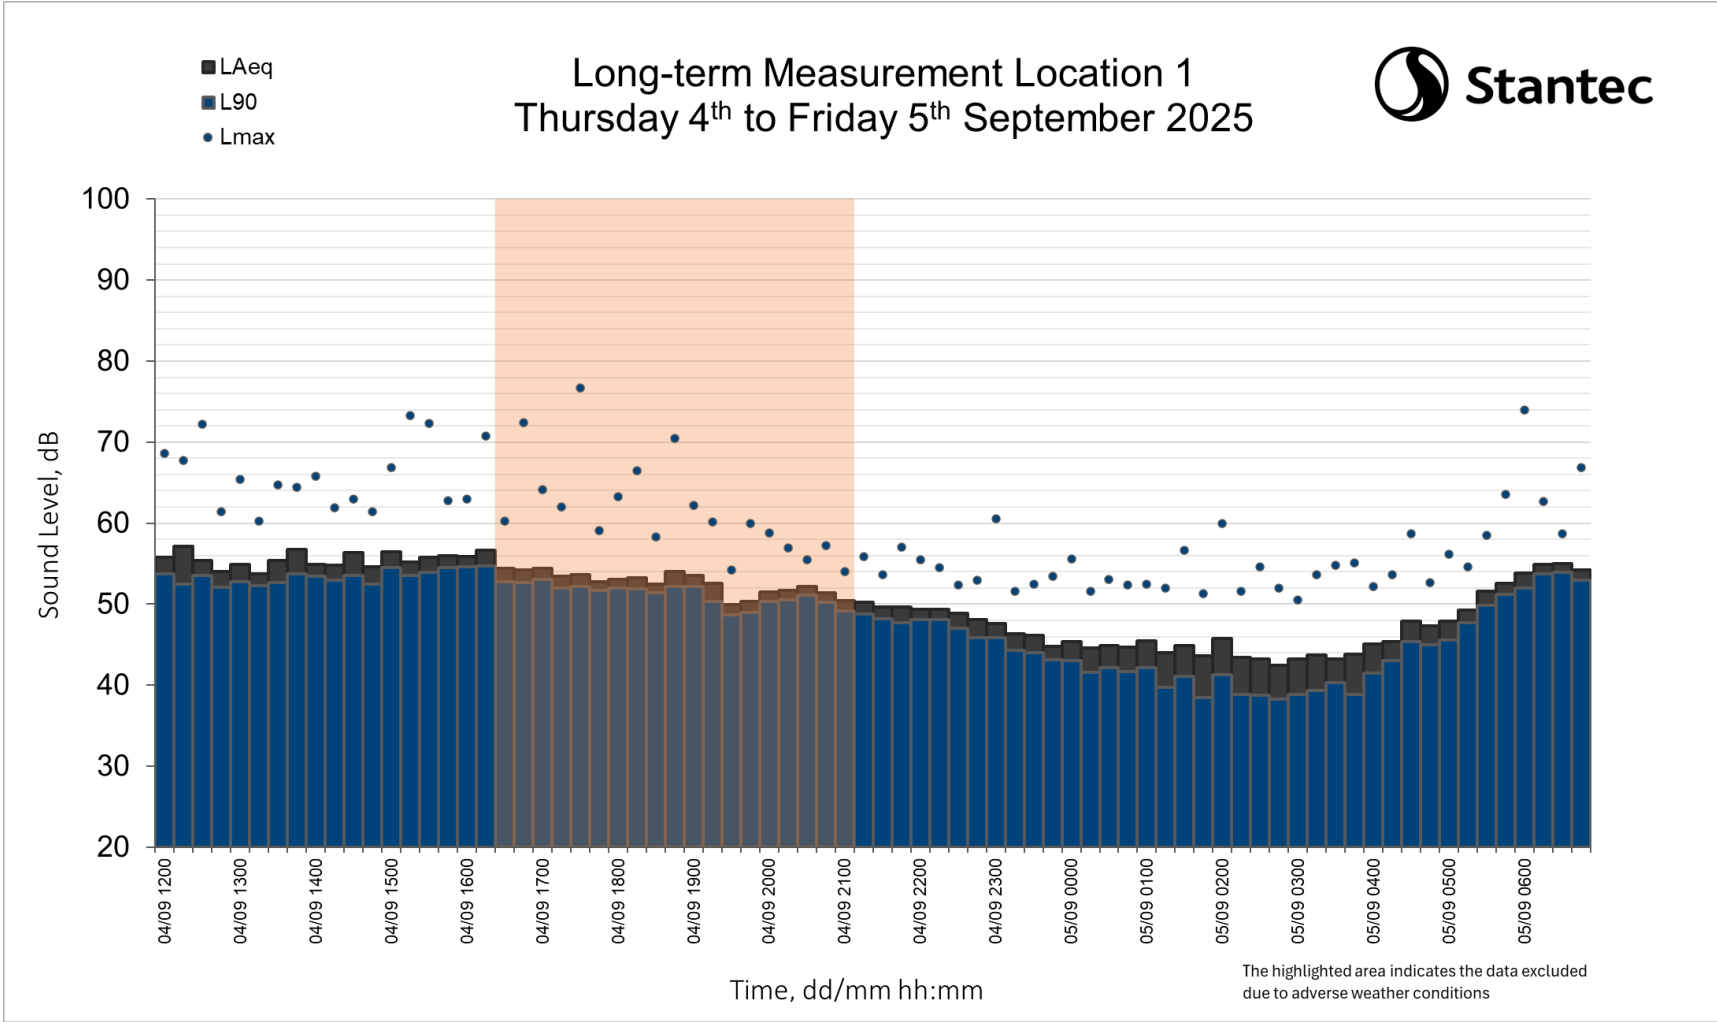


Long-term Measurement Location 1
Friday 5th to Saturday 6th September 2025

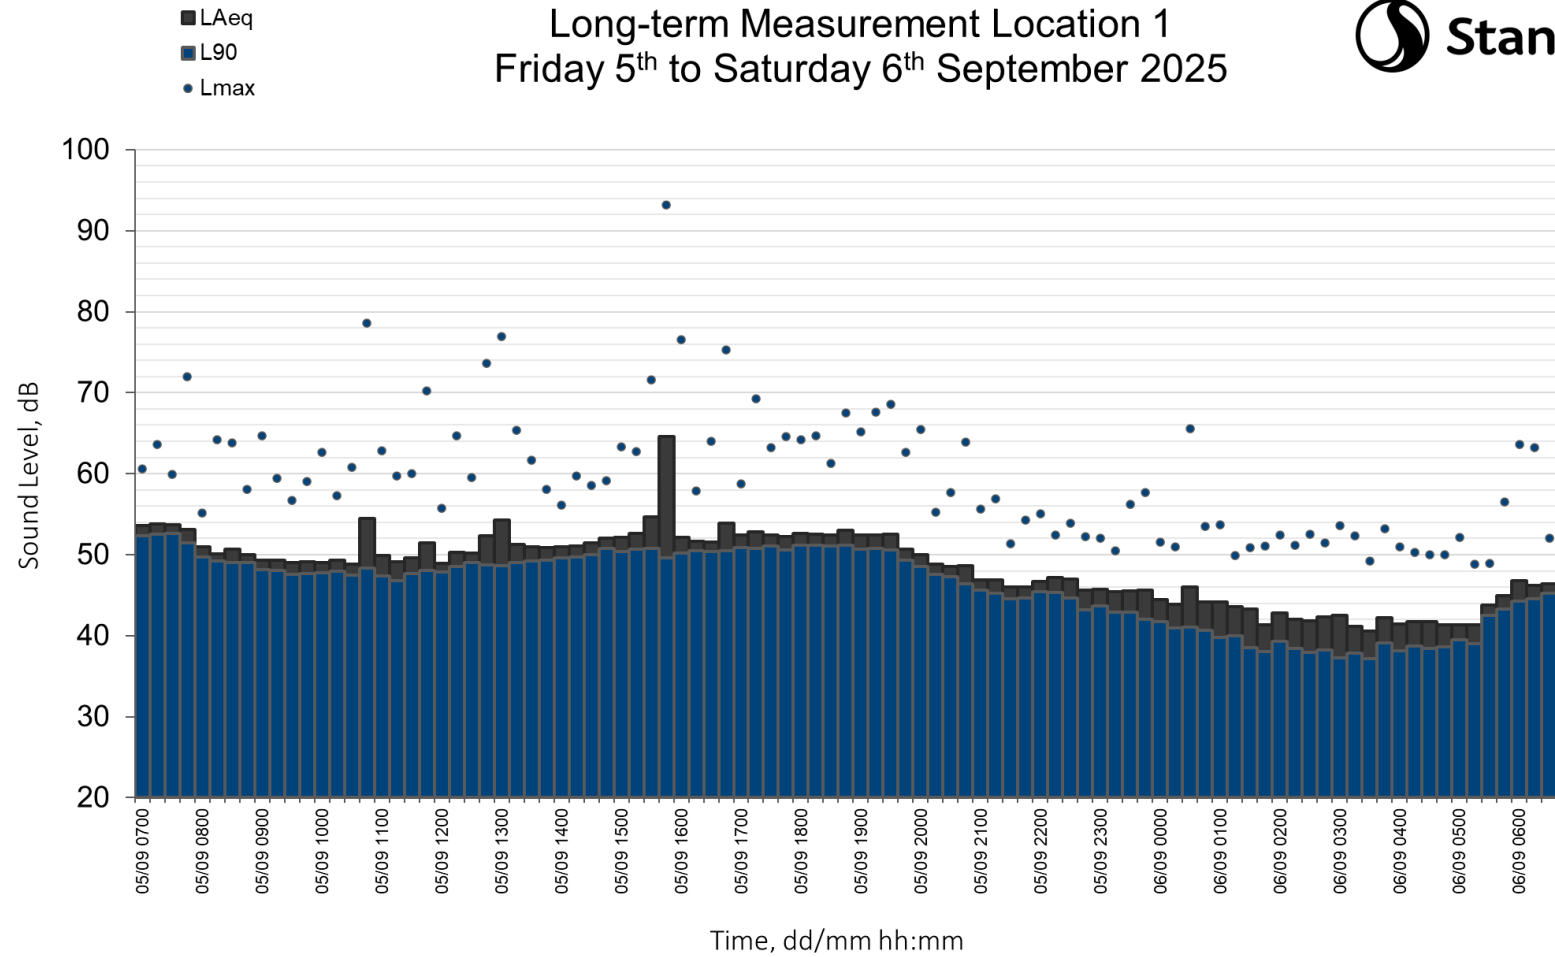


Long-term Measurement Location 1
Saturday 6th to Sunday 7th September 2025

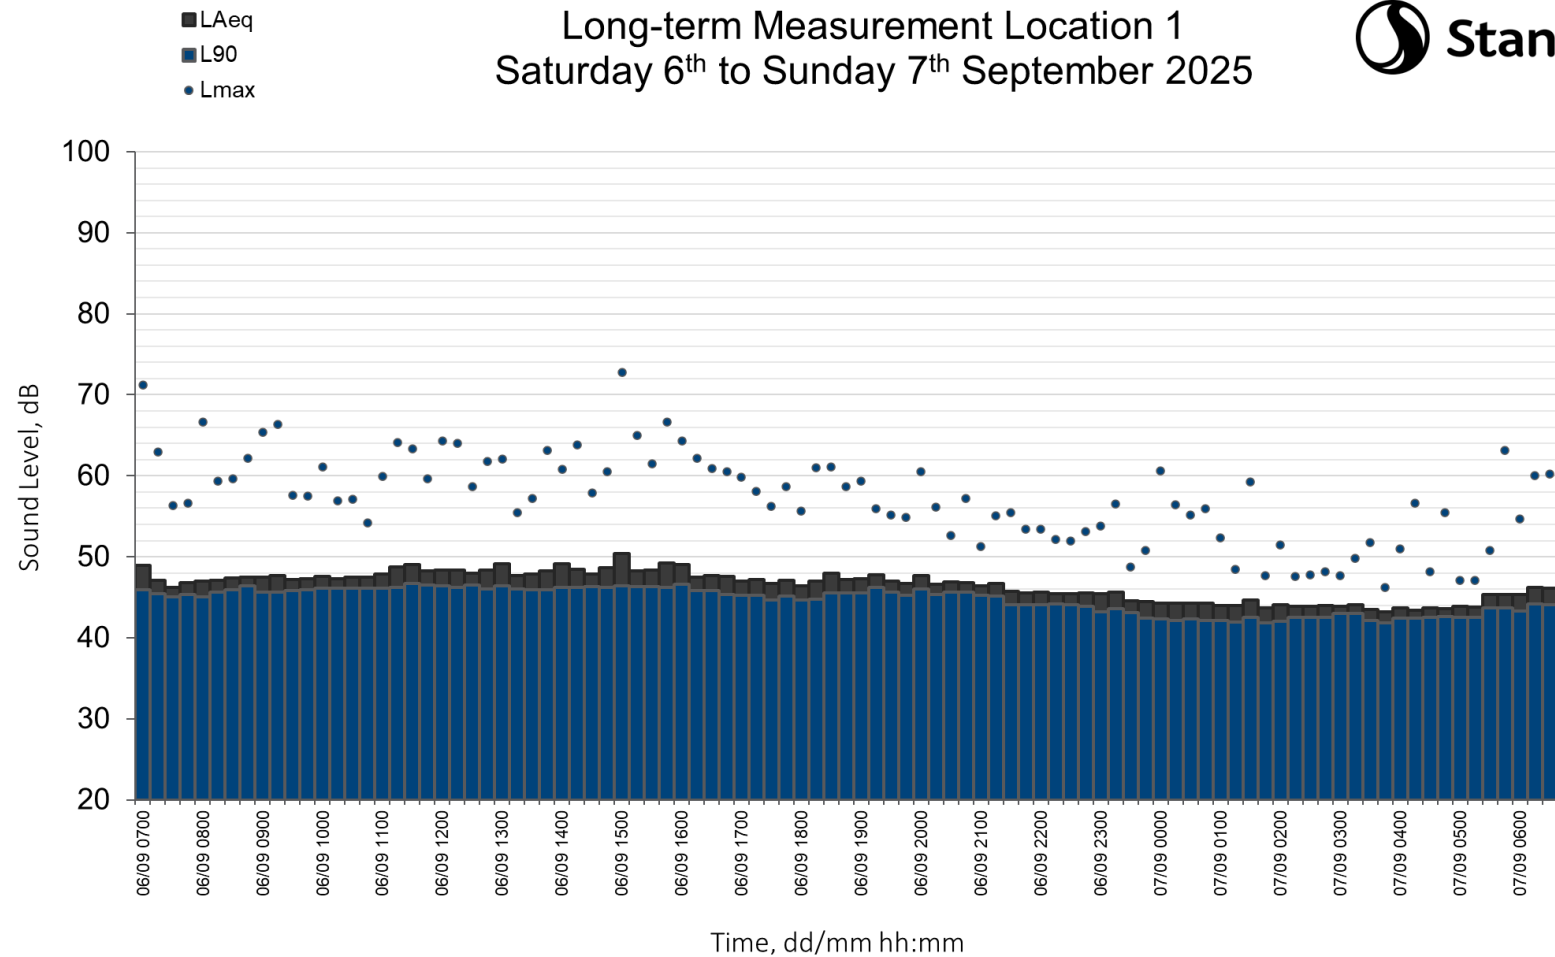

Long-term Measurement Location 1
Sunday 7th to Monday 8th September 2025

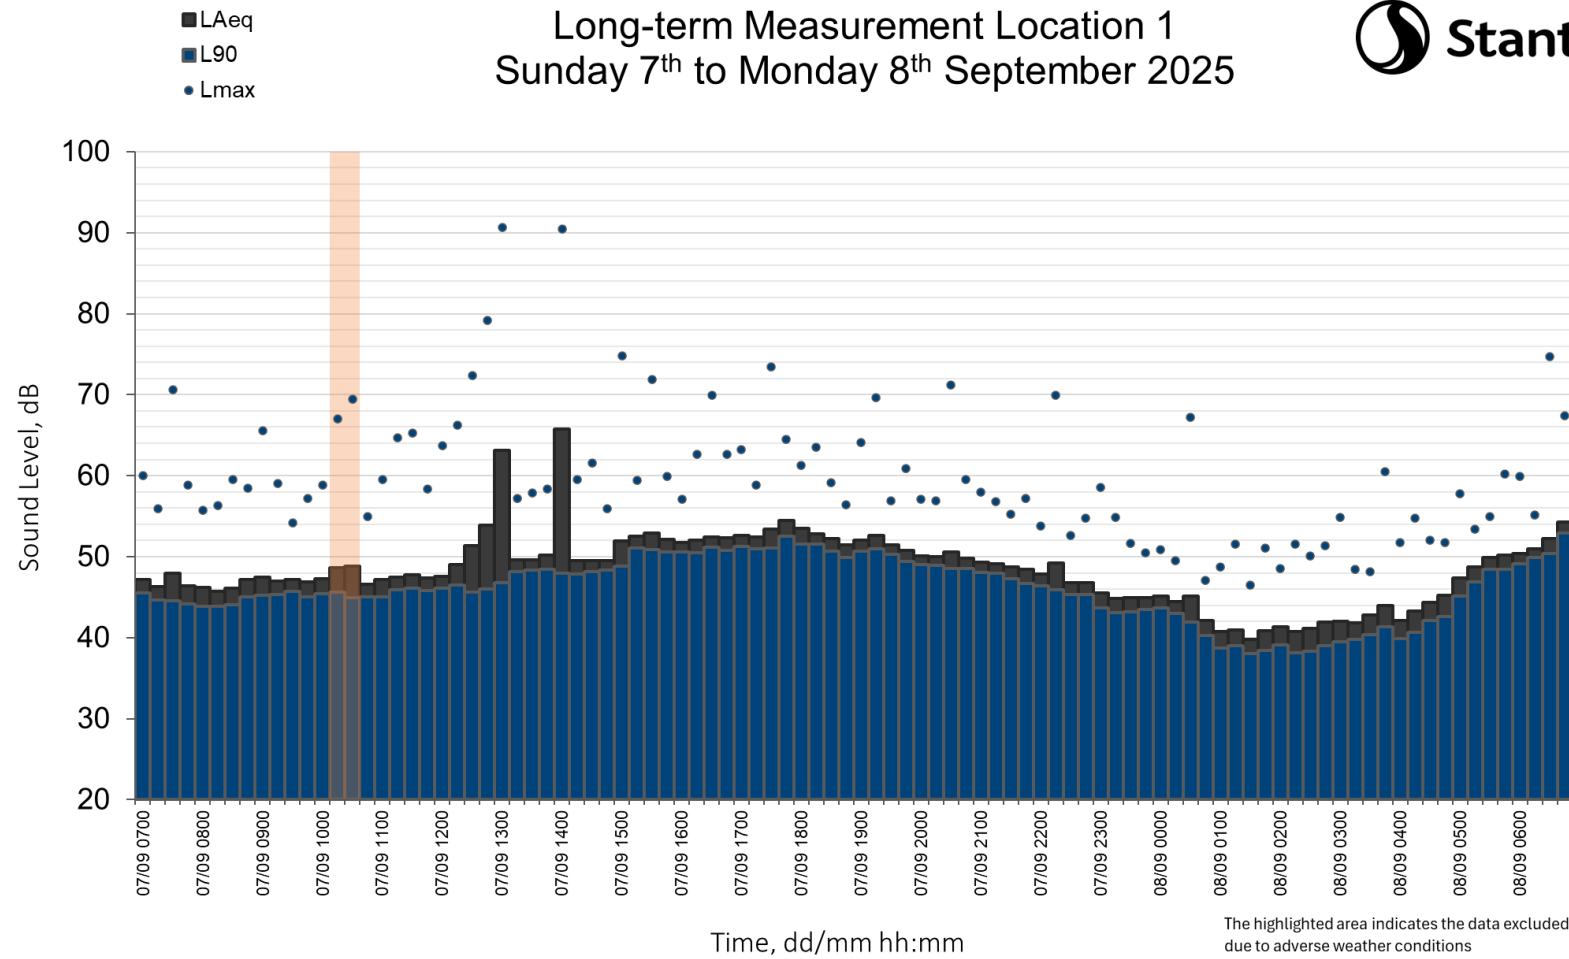

Long-term Measurement Location 1
Monday 8th September 2025

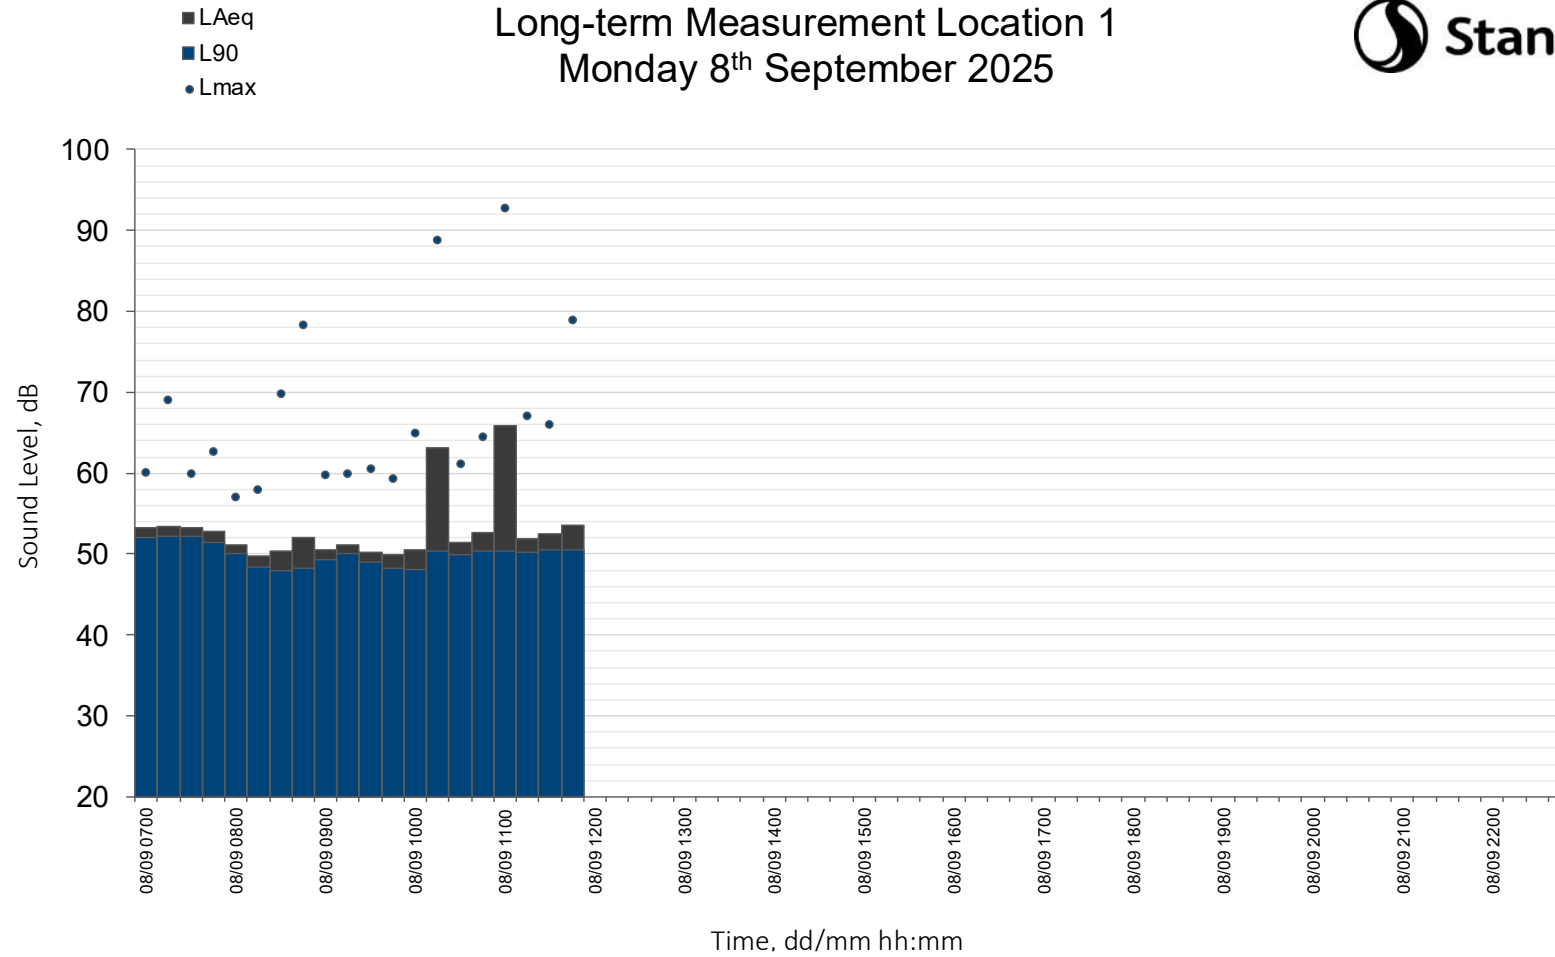

Appendix D Traffic Data (Provided by Paul Basham Associates)

Plot 400

Road name	Scenario	Total Vehicles		HGV%	
		18-hour AAWT (06:00-24:00)	8-hour (AAWT) 23:00-07:00	18-hour AAWT (06:00-24:00)	8-hour (AAWT) 23:00-07:00
Fitzwygram Way	2027 Opening year (without development)	1257	88	37.1%	18.9%
	2027 Opening year (with development)	1860	130	36.6%	18.9%
	2040 ² Future year (15 years after opening) (without development)	1370	96	37.1%	18.9%
	2040 ^{Error! Bookmark not defined.} Future year (15 years after opening) (with development)	1973	138	36.6%	18.9%

Plot 600

Road name	Scenario	Total Vehicles		HGV%	
		18-hour AAWT (06:00-24:00)	8-hour (AAWT) 23:00-07:00	18-hour AAWT (06:00-24:00)	8-hour (AAWT) 23:00-07:00
Fitzwygram Way	2027 Opening year (without development)	1257	88	37.1%	18.9%
	2027 Opening year (with development)	1355	95	36.6%	18.9%
	2040 ^{Error! Bookmark not defined.} Future year (15 years after opening) (without development)	1370	96	37.1%	18.9%
	2040 ^{Error! Bookmark not defined.} Future year (15 years after opening) (with development)	1468	103	36.6%	18.9%

² The future assessment year is identified as 2042; however, traffic forecasts are based on 2040 data. This is because the TEMPro database, which is used for background traffic growth projections, currently only provides data up to 2040.

Plot 601

Road name	Scenario	Total Vehicles		HGV%	
		18-hour AAWT (06:00-24:00)	8-hour (AAWT) 23:00-07:00	18-hour AAWT (06:00-24:00)	8-hour (AAWT) 23:00-07:00
Fitzwygram Way	2027 Opening year (without development)	1257	88	37.1%	18.9%
	2027 Opening year (with development)	1661	116	36.6%	18.9%
	2040Error! Bookmark not defined. Future year (15 years after opening) (without development)	1370	96	37.1%	18.9%
	2040Error! Bookmark not defined. Future year (15 years after opening) (with development)	1774	82	36.6%	18.9%

Assumptions:

1. Development traffic is assumed to route to/from the SRN via the A3(M).
2. Overnight trips (7% of 18-hour AAWT) are based on Fitzwygram Way survey results.
3. HGV proportion assumed as 18.85% in line with the Fitzwygram Way survey.
4. B8 Warehousing (Commercial) land use adopted for assessment.
5. Assessment based on the outline application floor area for Unit 400.
6. Traffic growth projected to 2040 (15 years from 2027), as TEMPro data currently extend to 2040.
7. Background HGV traffic assumed to grow at the same rate as total vehicle traffic.

Appendix E Modelling Assumptions


The following general calculation methodologies and assumptions were adopted and implemented into the acoustic model:

- Mapping of the site and the surrounding area was imported into the noise model based on information provided by the design team and known Ordinance Survey grid reference points;
- The site terrain and heights of existing buildings have been imported using commercially available Digital Terrain Models (DTMs) and Digital Surfaces Models (DSMs) respectively. The terrain points were filtered to create ground contours and modified to the finished level of the site.
- Existing buildings, and committed developments, are incorporated within the acoustic model, to allow prediction of screening effects across the site. Buildings are assumed to have fully acoustically reflective facades;
- Noise propagation is predicted in accordance with ISO 9613-2:2024-01 'Acoustics – Attenuation of sound during propagation outdoors – Part 2: General Method of calculation' (ISO9613);
- To reflect the local ground cover, ground absorption was set to $G = 0.2$ for majority hard ground; and $G = 0.8$ for soft ground.
- 3rd order reflections included in calculation model to accurately analyse reflected characteristics of cooling plant.


Appendix F Potential Industrial Impact



Noise Impact Assessment
Appendix F Potential Industrial Impact

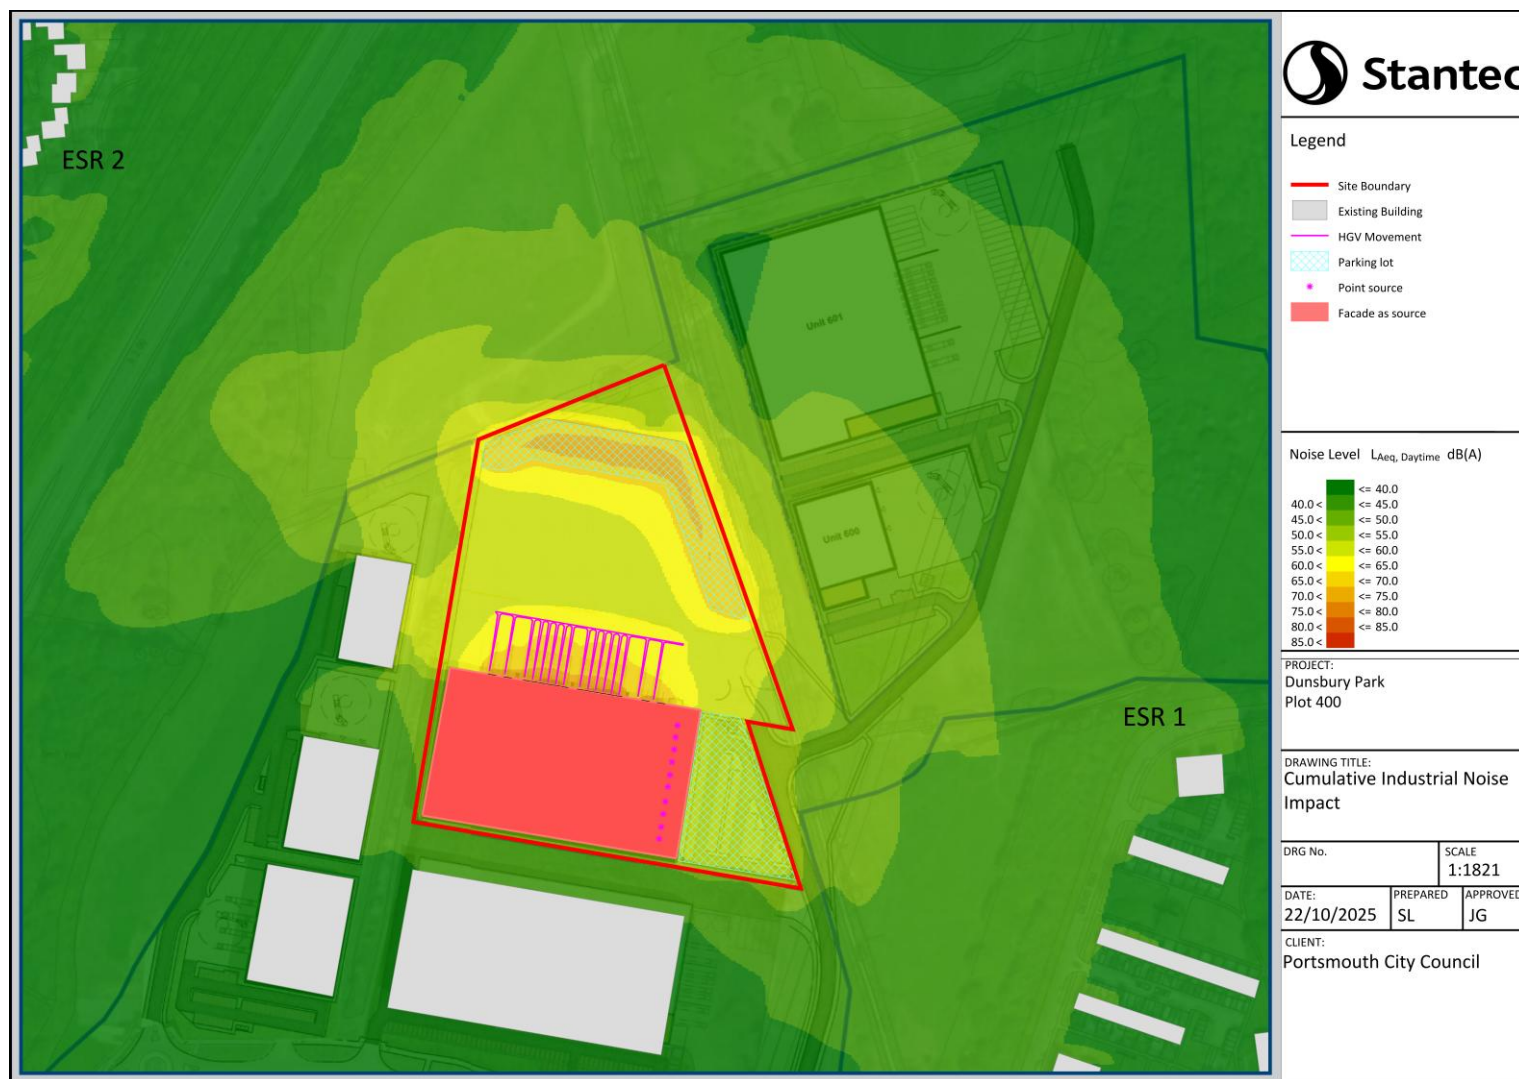


Noise Impact Assessment
Appendix F Potential Industrial Impact

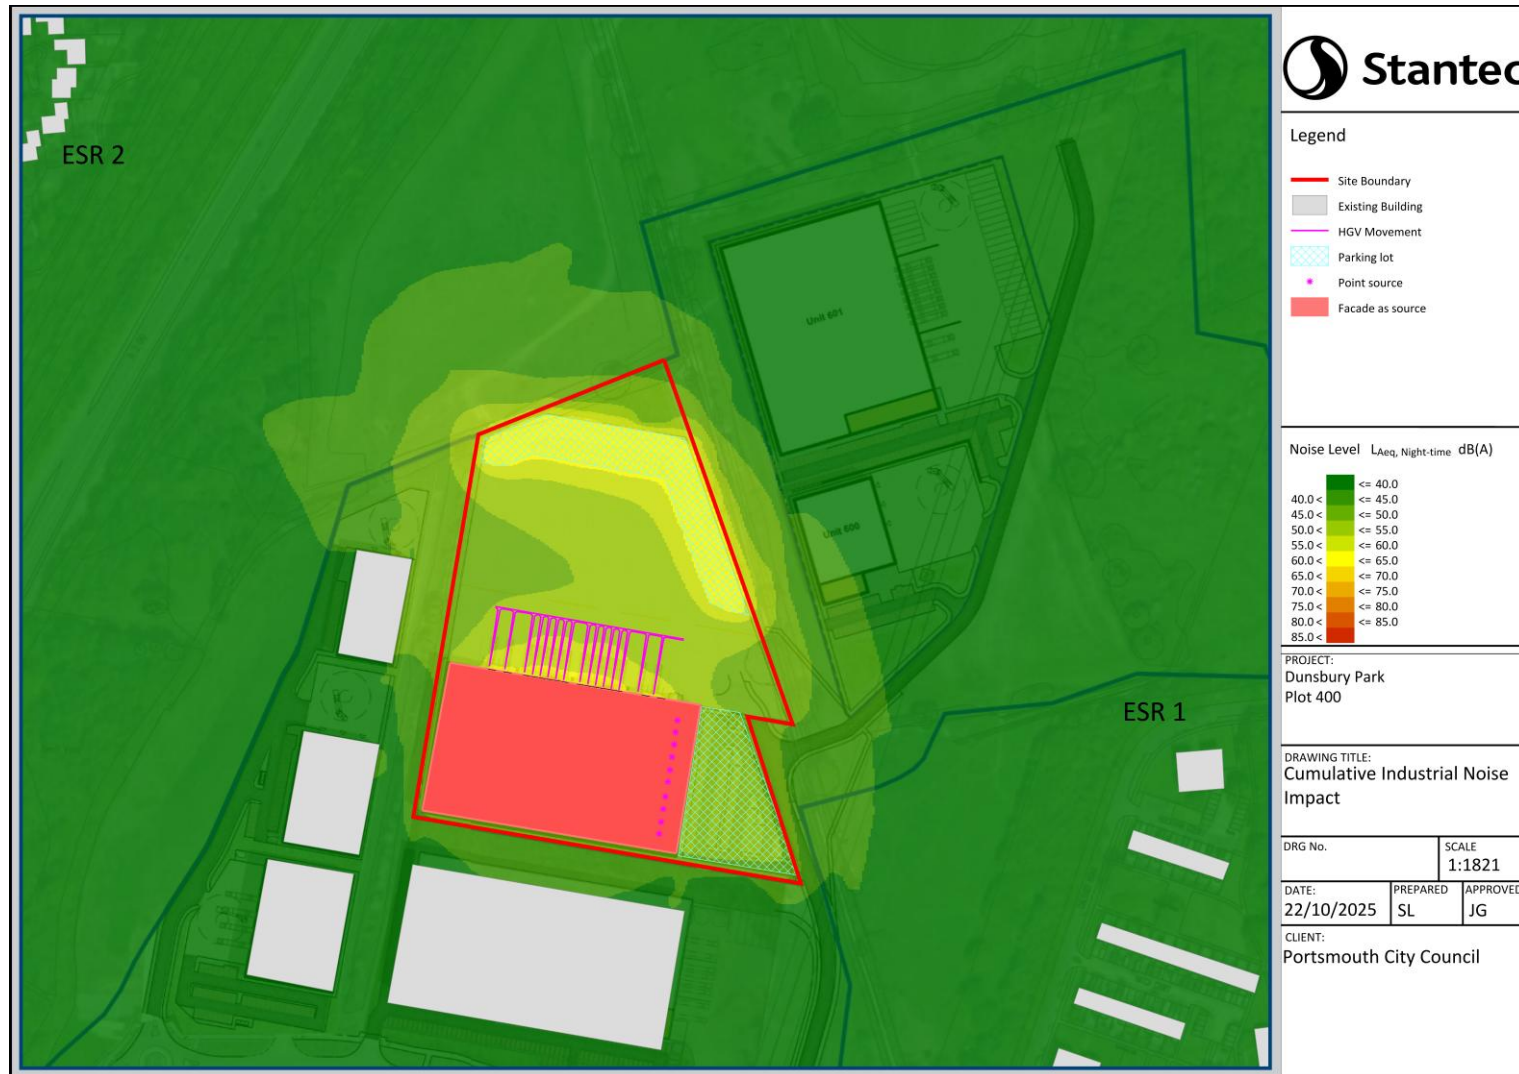


Appendix G Cumulative Industrial Impact



Noise Impact Assessment
Appendix G Cumulative Industrial Impact

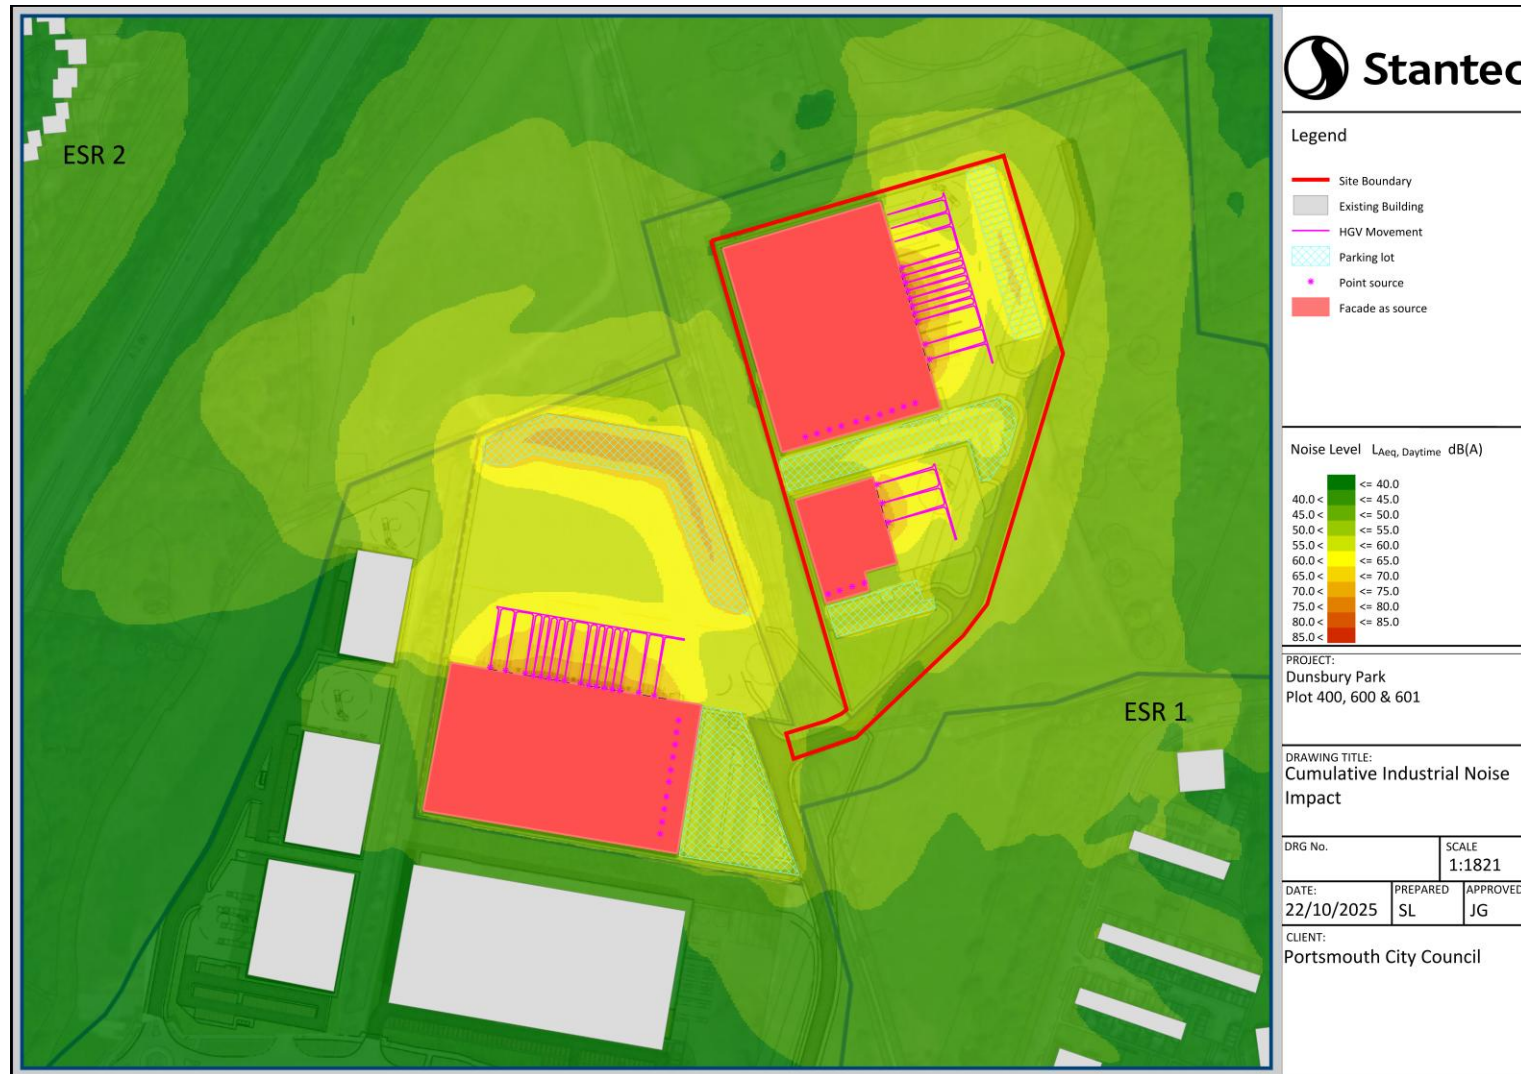

Noise Impact Assessment
Appendix G Cumulative Industrial Impact

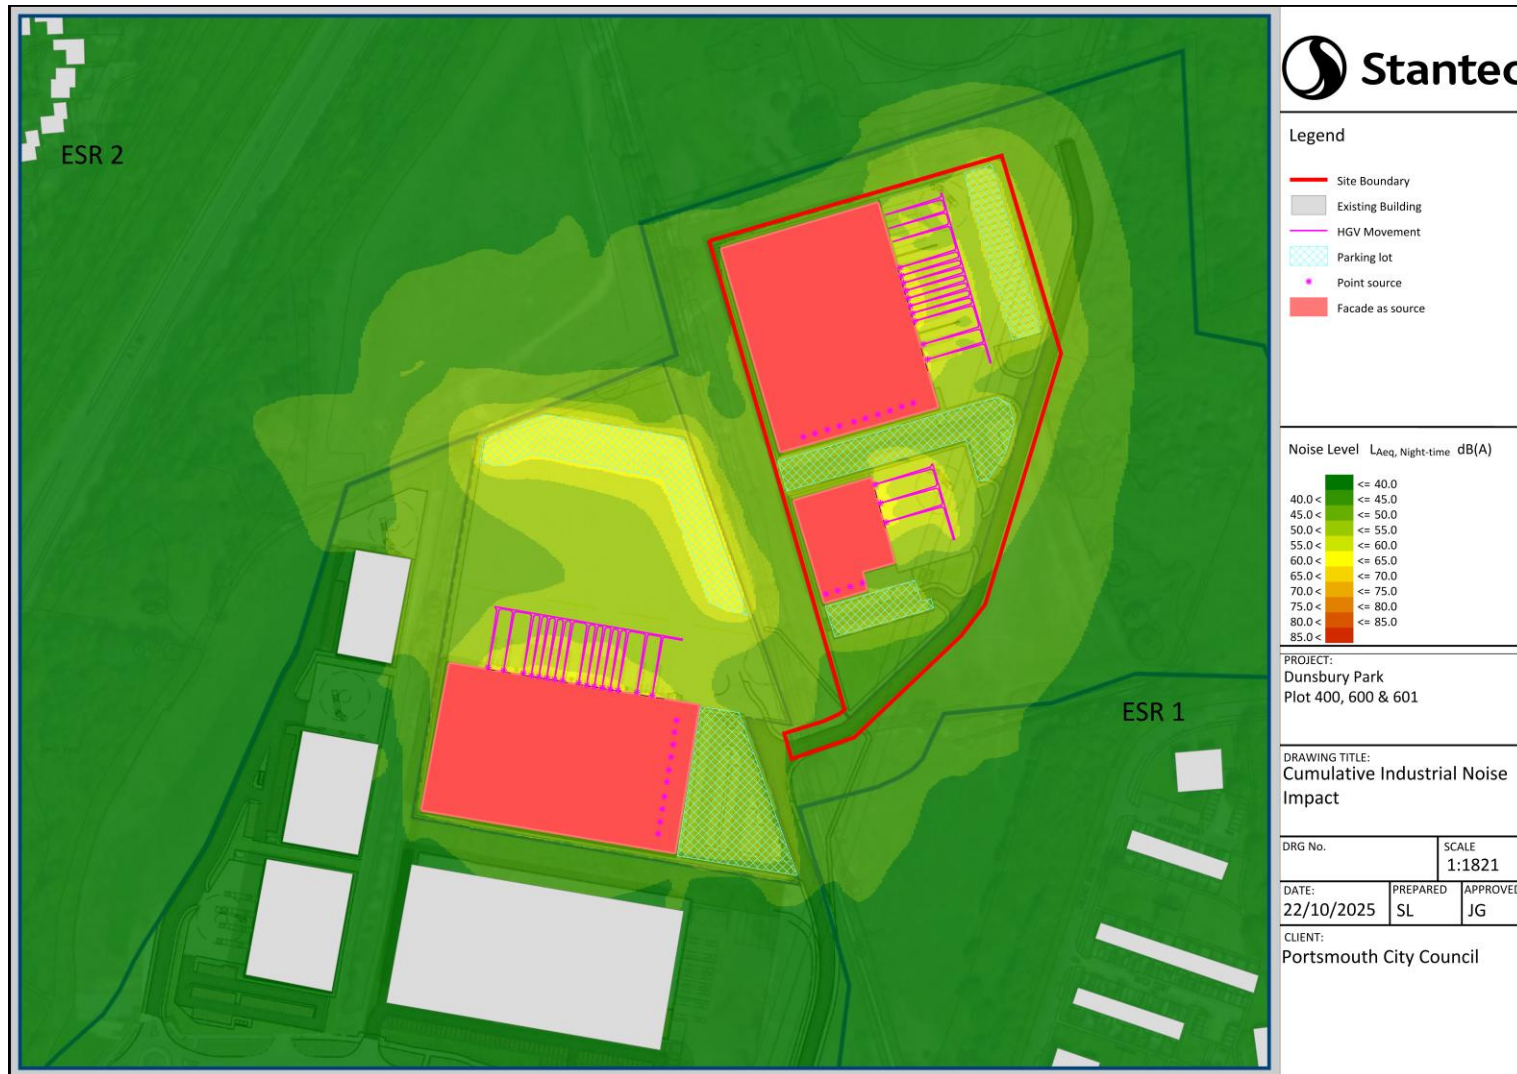

With every community, we redefine what's possible.



Stantec is a global leader in sustainable engineering, architecture, and environmental consulting. The diverse perspectives of our partners and interested parties drive us to think beyond what's previously been done on critical issues like climate change, digital transformation, and future-proofing our cities and infrastructure. We innovate at the intersection of community, creativity, and client relationships to advance communities everywhere, so that together we can redefine what's possible.

Stantec UK Limited
Great Suffolk Yard
127-131 Great Suffolk Street
London
SE1 1PP
UNITED KINGDOM
stantec.com