


GENERAL NOTES:



Ventilation					
Location	Indoor Ref	Manufacturer	Model	Control	Power Supply Required
Back of House	KEF01	Systemair	MUB/T 062 560	Inverter	3oh 20A

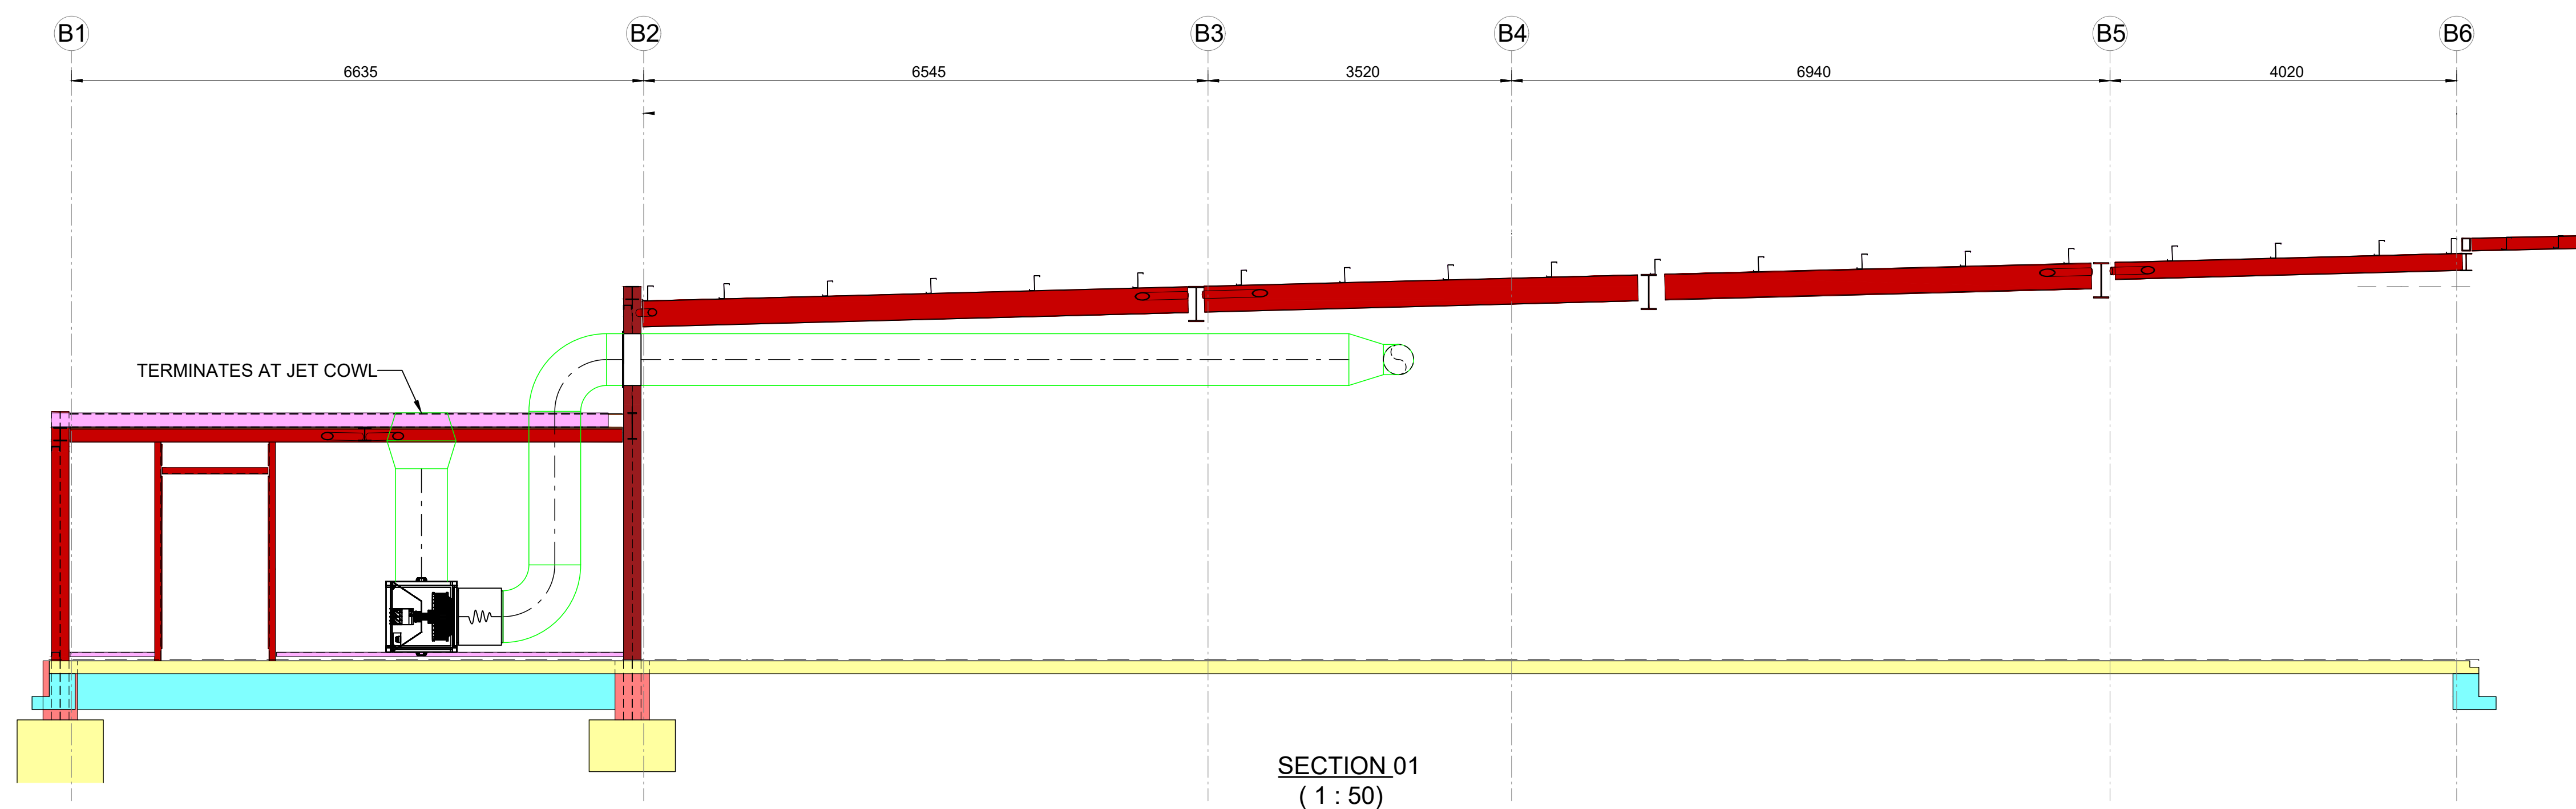

SITE: KFC WATERLOOVILLE	
CLIENT: K & Z HOLDINGS	
TITLE: EXTRACT VENTILATION ELEVATION DRAWING	
DRAWING BY: GW CHECKED BY: DP	
DATE: 22/05/2026	SCALE: NTS
PAPER SIZE: A1	
<div style="display: flex; justify-content: space-between; align-items: center;"> DRAWING NO. REV </div> <div style="display: flex; justify-content: space-between; align-items: center;"> I0001410-KZH-00-DR-03 0 </div>	