


SINGLE STOREY FRONT/SIDE ADDITIONS 26, HAVANT ROAD, HAYLING IS. HANTS FOR MR & MRS T. NORGATE.



FIT NEW RADIATORS WITH TRV VALVES

ELECTRICAL INSTALLATION BY APPROVED
CERTIFICATED ELECTRICIAN TO COMPLY WITH
APPROVED DOCUMENT P.
CERTIFICATE TO BE ISSUED ON COMPLETION OF WORK.
BY COMPETENT APPROVED CERTIFICATED ELECTRICIAN
USE ENERGY EFFICIENT LIGHT BULBS AND FITTINGS.

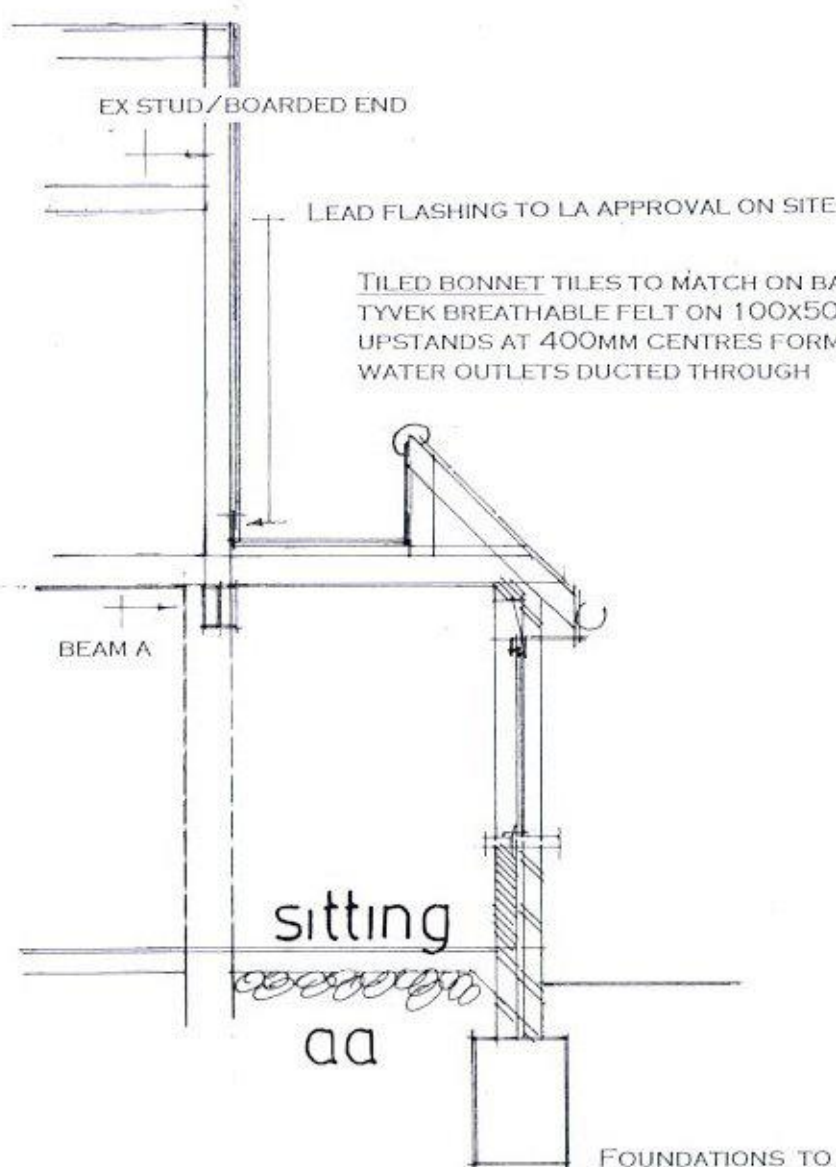

WALLS BRICKWORK PAINTED TO MATCH EXTERNALLY
100MM CAVITY WITH 50MM CELOTEX INSULATION
CLIPPED TO AN INSIDE SKIN OF 100MM CELCON SOLAR
BLOCKS INTERNALLY RENDER AND SET TIE WALLS WITH
APPROVED STAINLESS STEEL WALL TIES EVERY 750MM
HORIZONTALLY AND 450MM VERTICALLY

CATNIC LINTELS OVER ALL NEW OPENINGS, SIZE IN
ACCORDANCE WITH THE MANUFACTURERS SPAN
TABLES MINIMUM 150MM END BEARINGS.

STRAP DOWN NEW ROOFS WITH MILD STEEL ANCHORS
MINIMUM CROSS-SECTION 30MMX5MM AND AT 1.2M
CENTRES.
CLOSE TOP OF NEW CAVITY WALLS WITH BRICKWORK.


WINDOWS TO BE DOUBLE AND TO ACHIEVE A U VALUE
OF 1.6W/M2K TO GIVE A MINIMUM 1/20TH OF THE
FLOOR AREA AS OPENING. PROVIDE 10,000 MM SQ.
TRICKLE VENTS TO ALL NEW ROOMS. ANY LOW LEVEL
GLAZING TO CRITICAL AREAS IN
DOORS/WINDOWS/SIDELIGHTS ETC. TO BE SAFETY
GLASS TO B.S 6206

RAINWATER DISPOSAL VIA 100MM DIAMETER GUTTERS
AND DOWNPIPE TO PICKUP INTO EXISTING SURFACE
WATER DRAINS IF FOUND AVAILABLE TO LA APPROVAL
ON SITE, ALTERNATIVELY TO NEW SOAKAWAYS MIN 5M
FROM ANY BUILDING AND MIN 1M/3

FOUNDATIONS TO LOCAL AUTHORITY APPROVAL TO SUIT
SITE CONDITIONS. USE ONLY CLASS A CONCRETE
BLOCKS BELOW GROUND LEVEL. FOUNDATIONS ALSO TO
COMPLY WITH NHBC PRACTICE NOTE WITH REGARD TO
ANY TREES., TRENCH FILL FOUNDATIONS.

NOTE DUE TO THE CLOSE PROXIMITY OF EXISTING TREES
THE DEPTH OF THE FOUNDATIONS IS TO BE AGREED ON
SITE WITH THE LOCAL AUTHORITY BUILDING CONTROL
PRIOR THE COMMENCEMENT OF ANY WORK

FLAT ROOF 3 LAYERS ASBESTOS BASED FELT TO BS
747 LAID TO CP144, 12.5MM CHIPPINGS OVER ON
CELOTEX TD 4126 (126MM) THICK INSULATED ROOF
DECKING ON 150X50MM JOISTS AT 400MM CENTRES.
12.5MM PLASTERBOARD AND SET TO CEILING.
NOTE FIR ROOF TO FALL

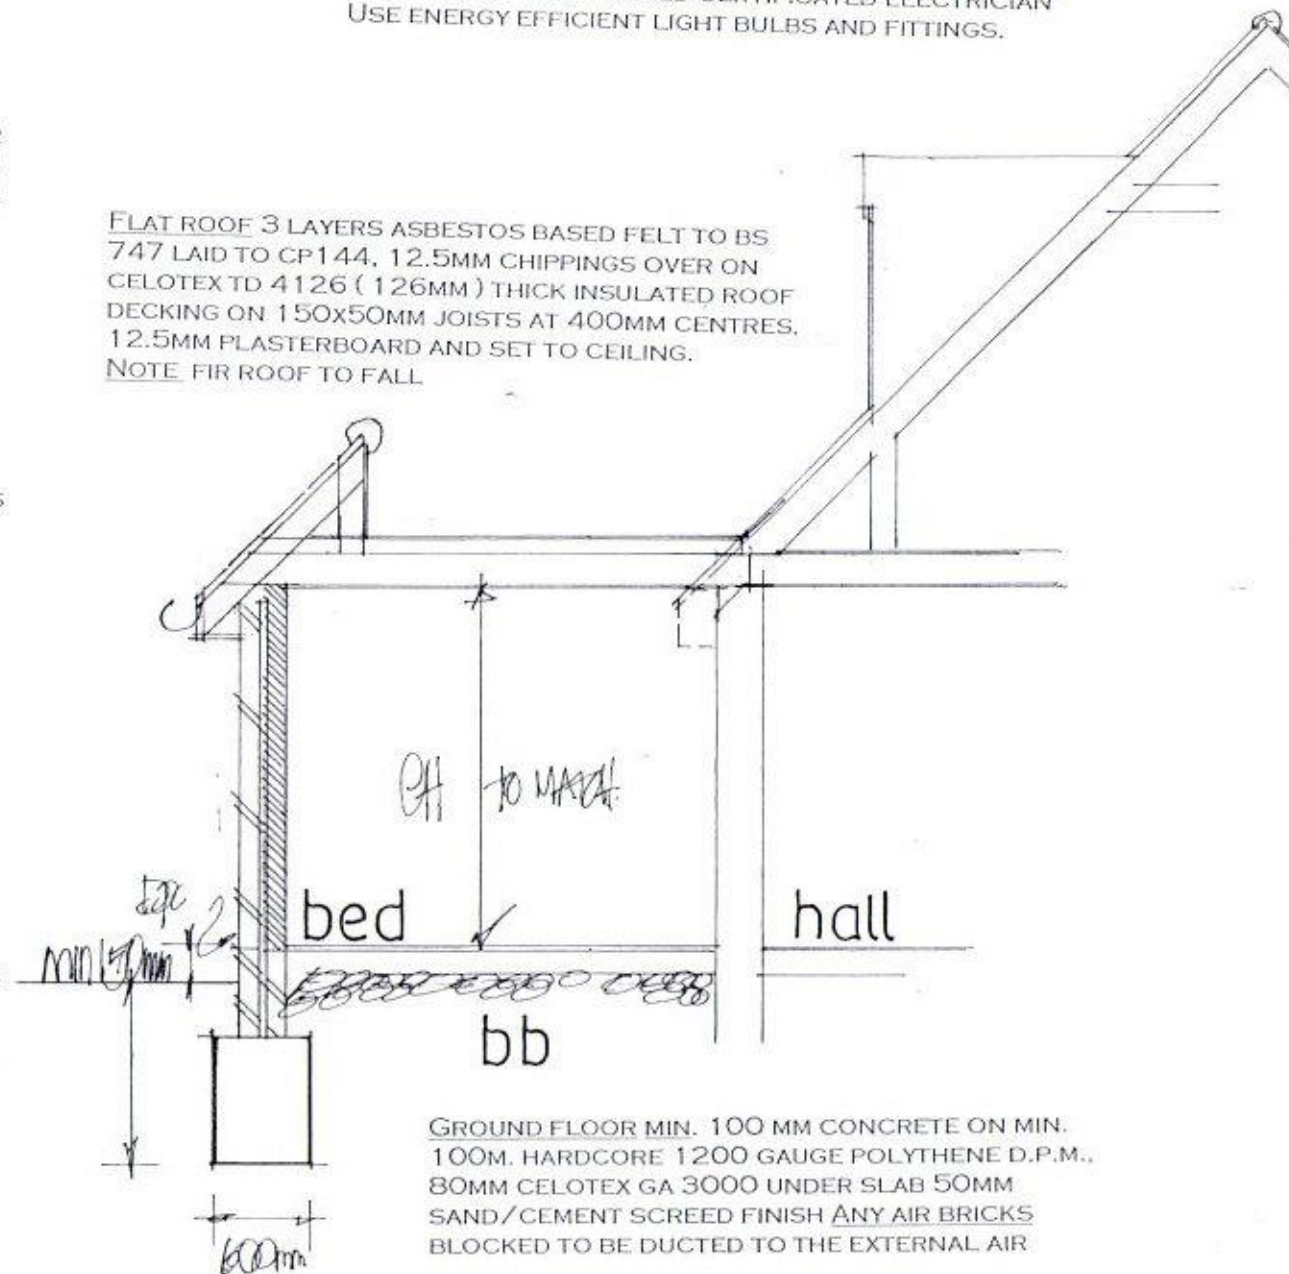

GROUND FLOOR MIN. 100 MM CONCRETE ON MIN.
100M. HARDCORE 1200 GAUGE POLYTHENE D.P.M.,
80MM CELOTEX GA 3000 UNDER SLAB 50MM
SAND/CEMENT SCREED FINISH ANY AIR BRICKS
BLOCKED TO BE DUCTED TO THE EXTERNAL AIR

date feb 17
scale 1:50

Section Drawing

PETER J. WALKER MRICS
CHARTERED SURVEYOR
182 SEAFRONT, HAYLING ISLAND, HANTS
PO11 9AN
TEL 02392467571