

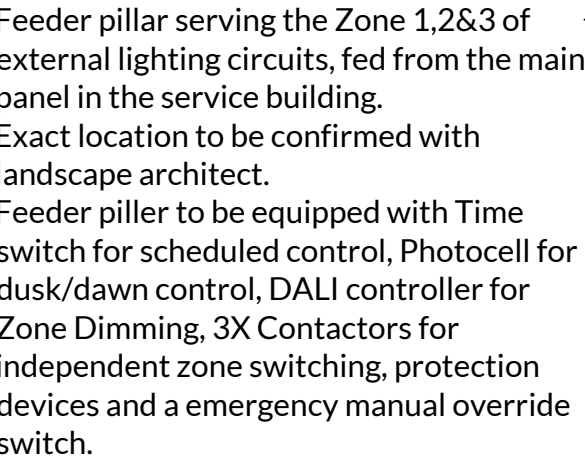


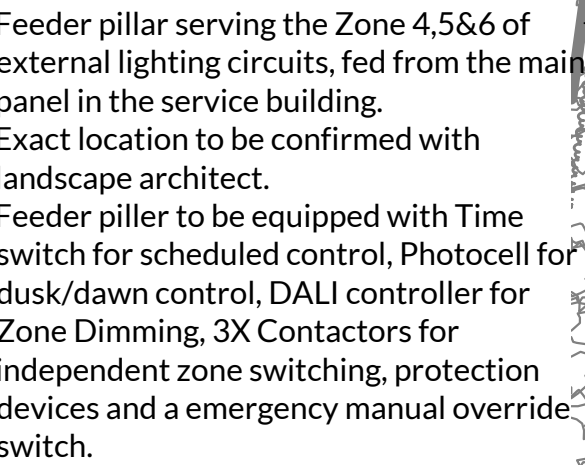

External lighting is to be in accordance with the protection of the bats in the surrounding environment. This is to be confirmed with a specialist.

All external lighting is to be hooded or otherwise shielded to prevent any upspill of light into the sky.

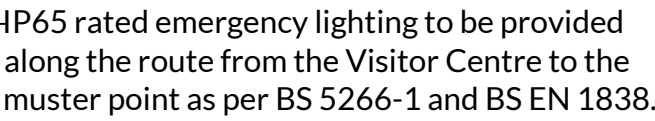

Lighting modeling is under development

1. All lighting is to be in accordance with the ecologists report.
2. External lighting will use timers and presence detection to ensure that lighting is available only when needed.
3. The use of warm lighting is to be utilised to reduce the amount of blue light.
4. A curfew for all external lighting will be set to the operational hours of the building, with a 30 minute delay to allow all visitors and staff to safely leave the site.
5. All lighting is hooded, or otherwise shielded to minimise any spillup into the sky.

Drawing Reference: HTR-RCD-00-00-DR-E-0001
Internal Reference: HTR-RCDC-03-XX-DR-E-6301