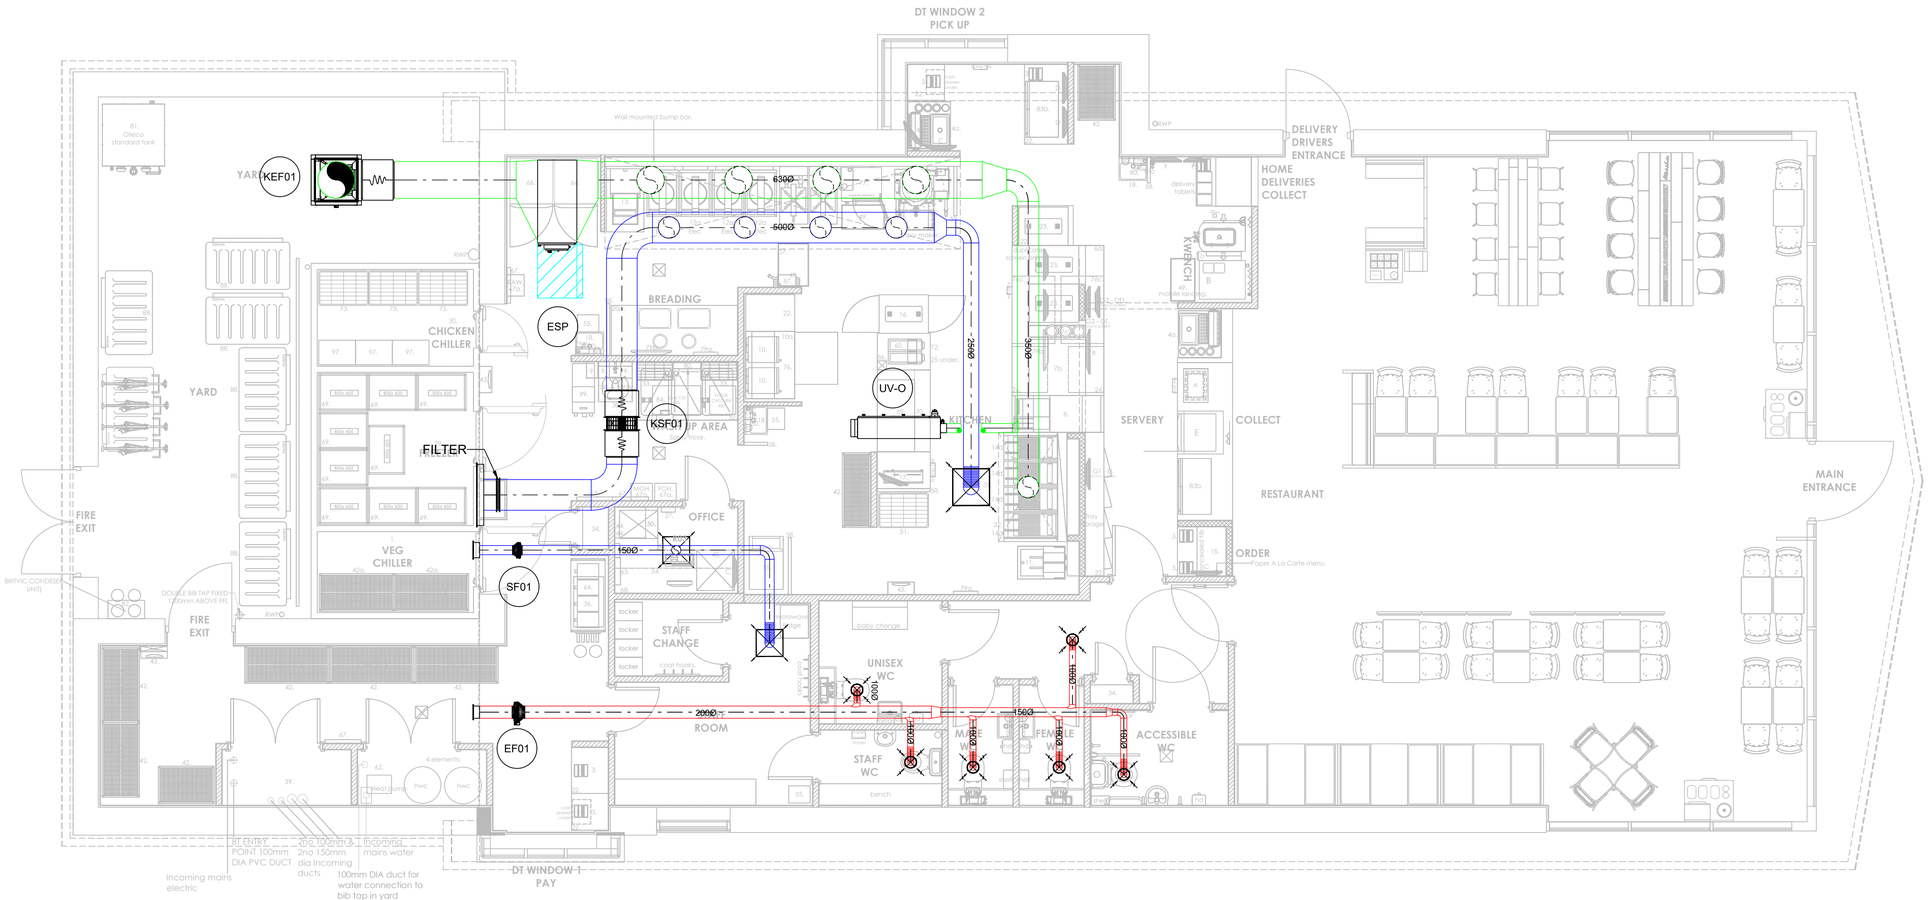

Ventilation					
Location	**Indoor Ref**	**Manufacturer**	**Model**	**Control**	**Power Supply Required**
WC Extract	EF01	Systemair	K200 Sileo	Actiate with Lights	On light supply for toilet
Office & Team Room Supply	SF01	Systemair	K150 Sileo	Activate with Lights	On light supply for Staff Room & Office
Back of House	KSF01	Systemair	AR500 Sileo	Speed Controller	1ph 10A
Back of House	KEF01	Systemair	MUB/T 062.560	Inverter	3ph 20A
Back of House	UV-O	Purified Air	UV-O1000		1ph 10A
Back of House	ESP	Purified Air	ESP4500		1ph 10A

GENERAL NOTES:

REV	DETAIL OF AMENDMENT	DATE
1	ESP ADDED	28.08.2026
2	UVO RELOCATION	25.09.2026

AirFlow Cooling

SITE: KFC WATERLOOVILLE

CLIENT: K & Z HOLDINGS

TITLE: PROPOSED VENTILATION LAYOUT

DRAWING BY: GW **CHECKED BY:** AC

DATE: 25/09/2026 | **SCALE:** 1:50 | **PAPER SIZE:** A1

DRAWING NO. I0001410-KZH-00-DR-02

REV **2**